





Transmission reliability 2015

Transmission reliability of Fingrid's grid

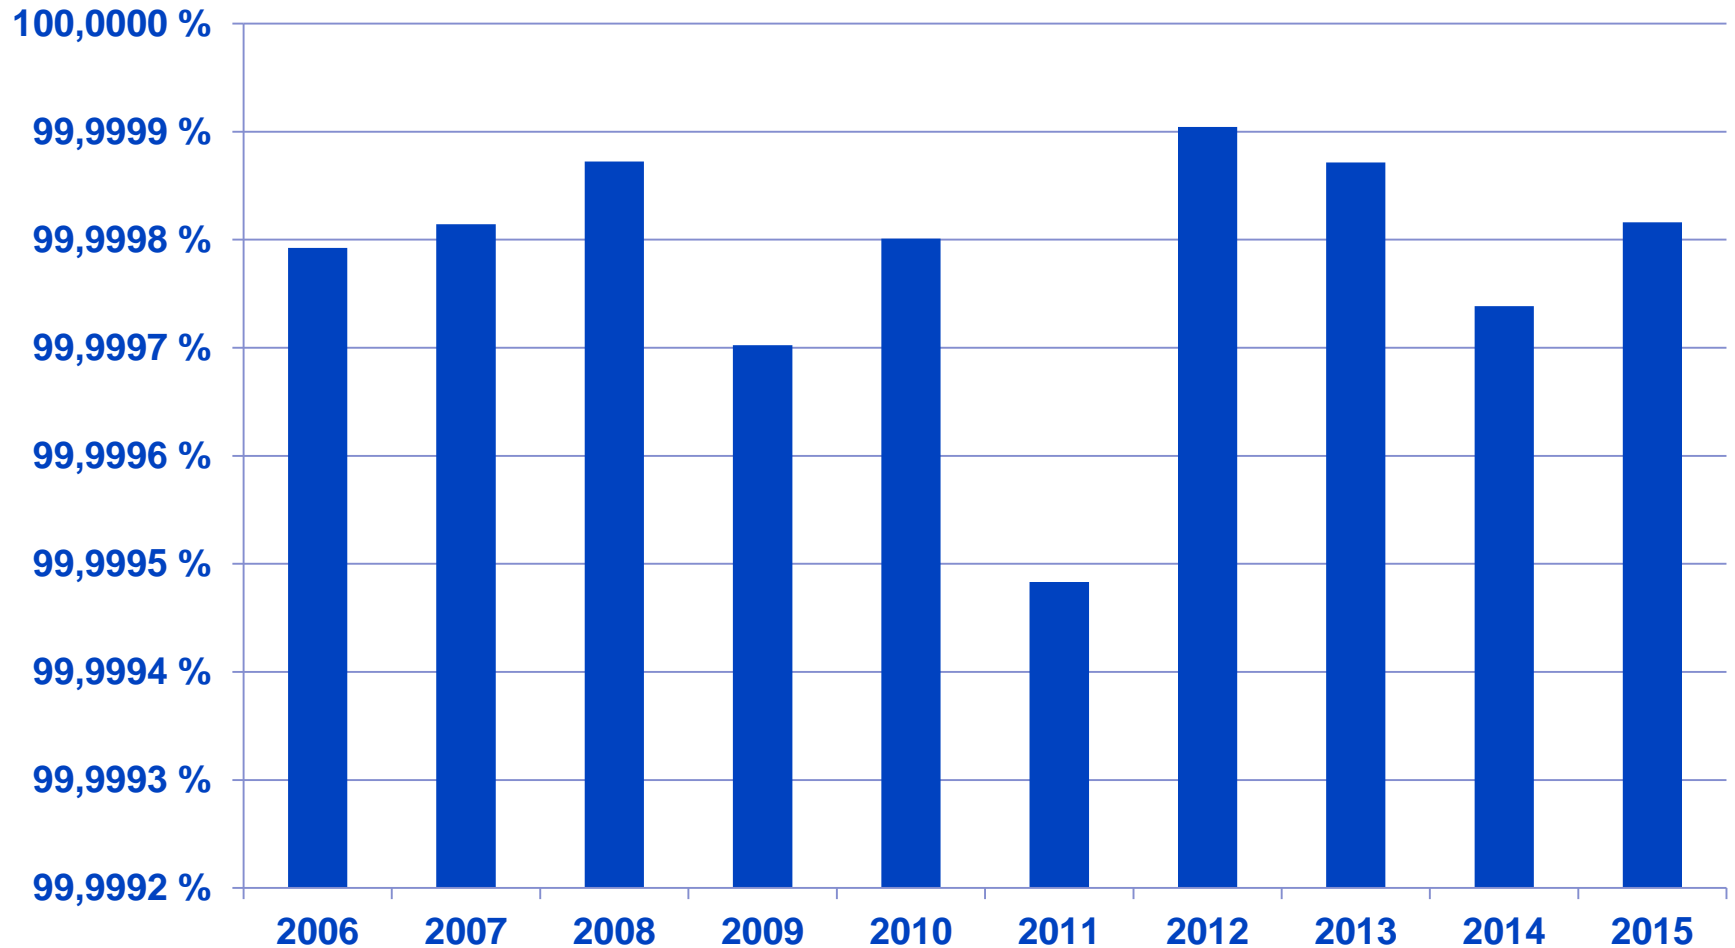


Transmission reliability = energy supplied / (energy supplied + energy not supplied due to disturbances)

Energy Not Supplied (MWh)

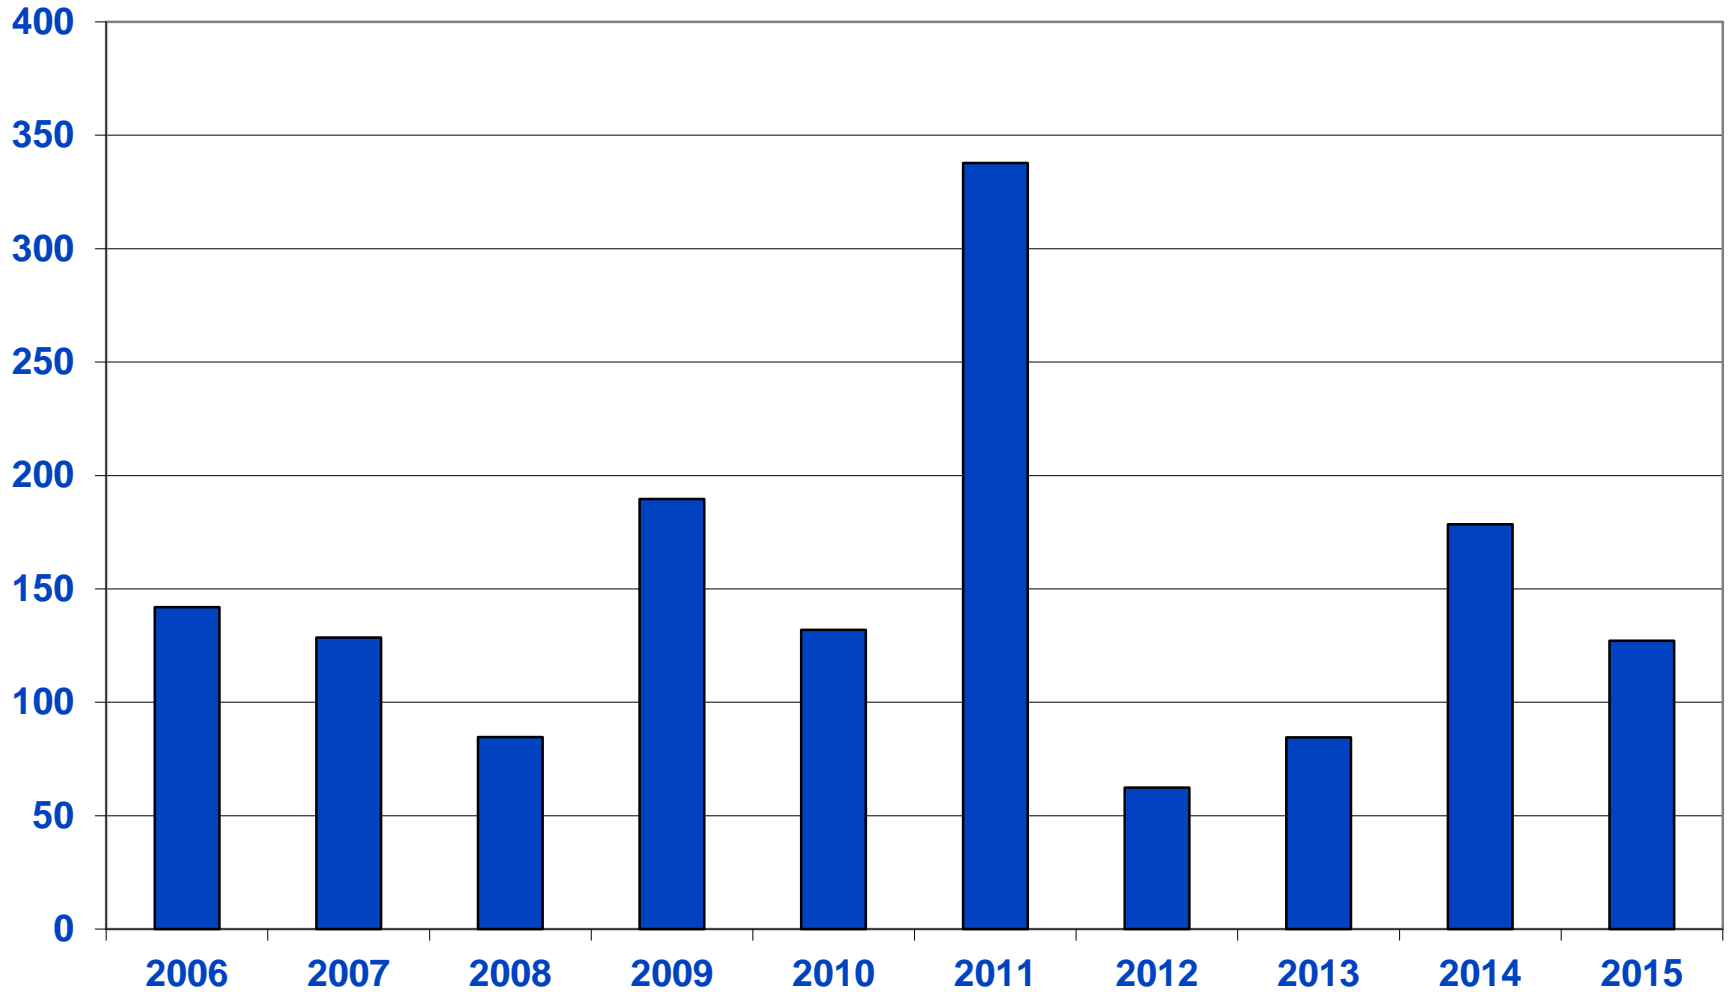

Connection point interruptions

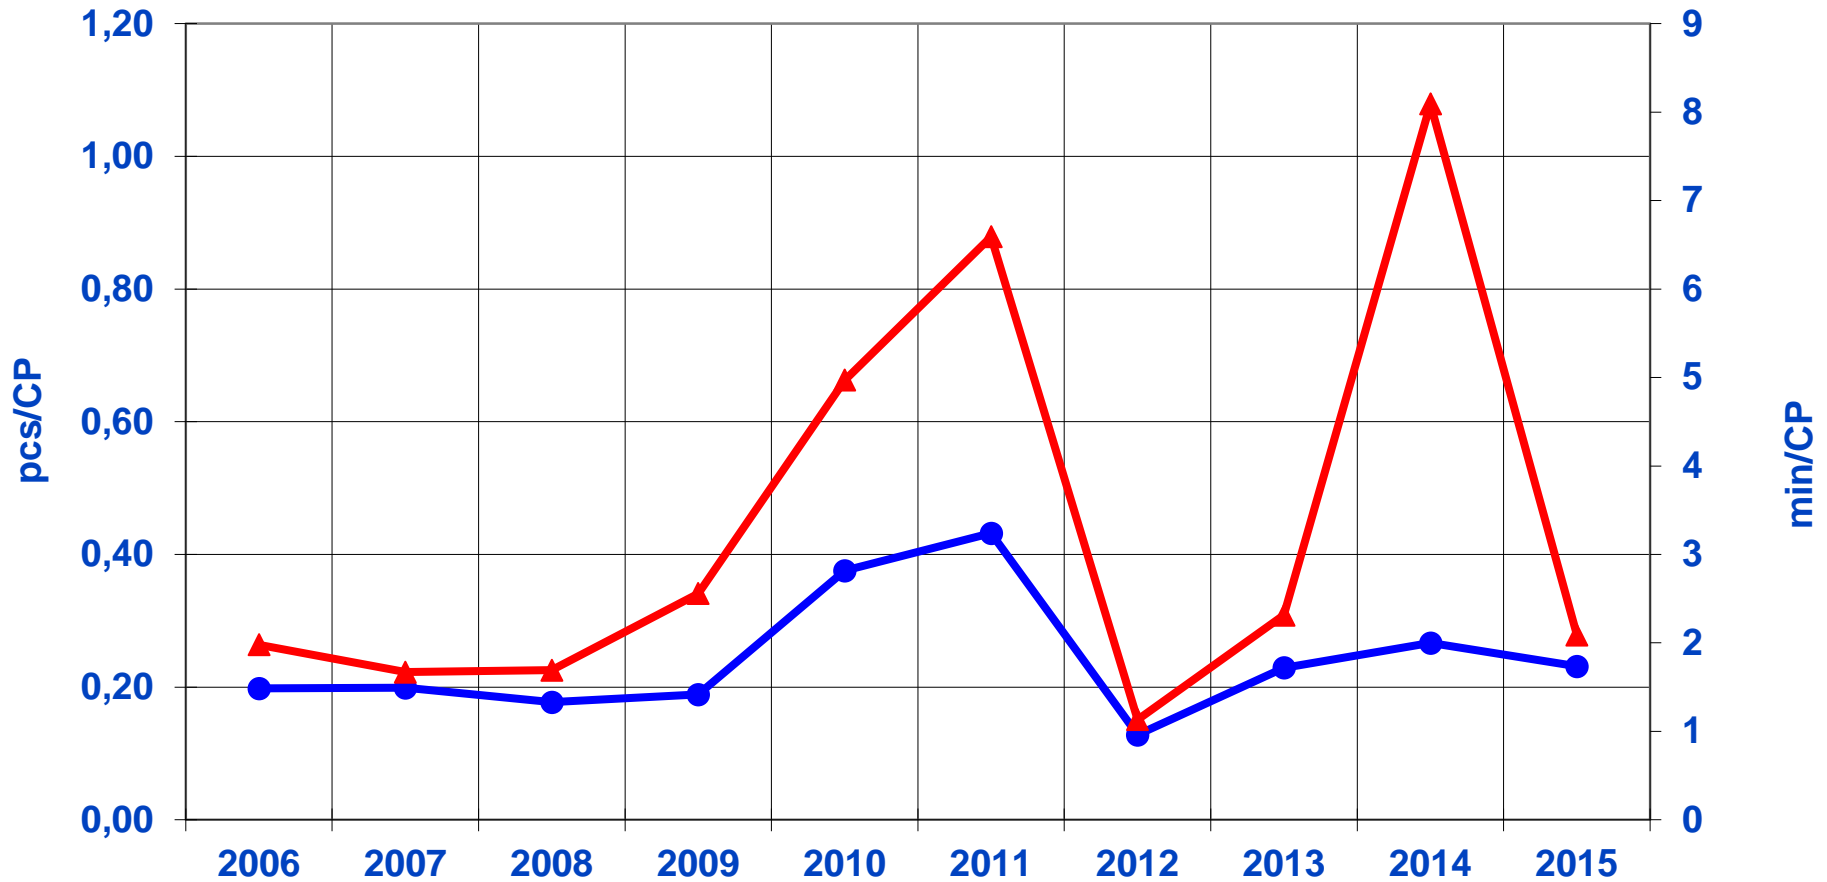

2010 Asta storm 29.7.2010.

2011 Tapani and Hannu storms 26.-27.12.2011.

2014 Felled tree on 110 kV line Hikiä-Forssa 24.3.2014. Circuit Breaker faults in Kainuu 28.7.2014.

● pcs / CP (≥ 30s) ▲ min / CP

Number and reasons of disturbances

