





Transmission reliability 2016

FINGRID


Transmission reliability of Fingrid's grid

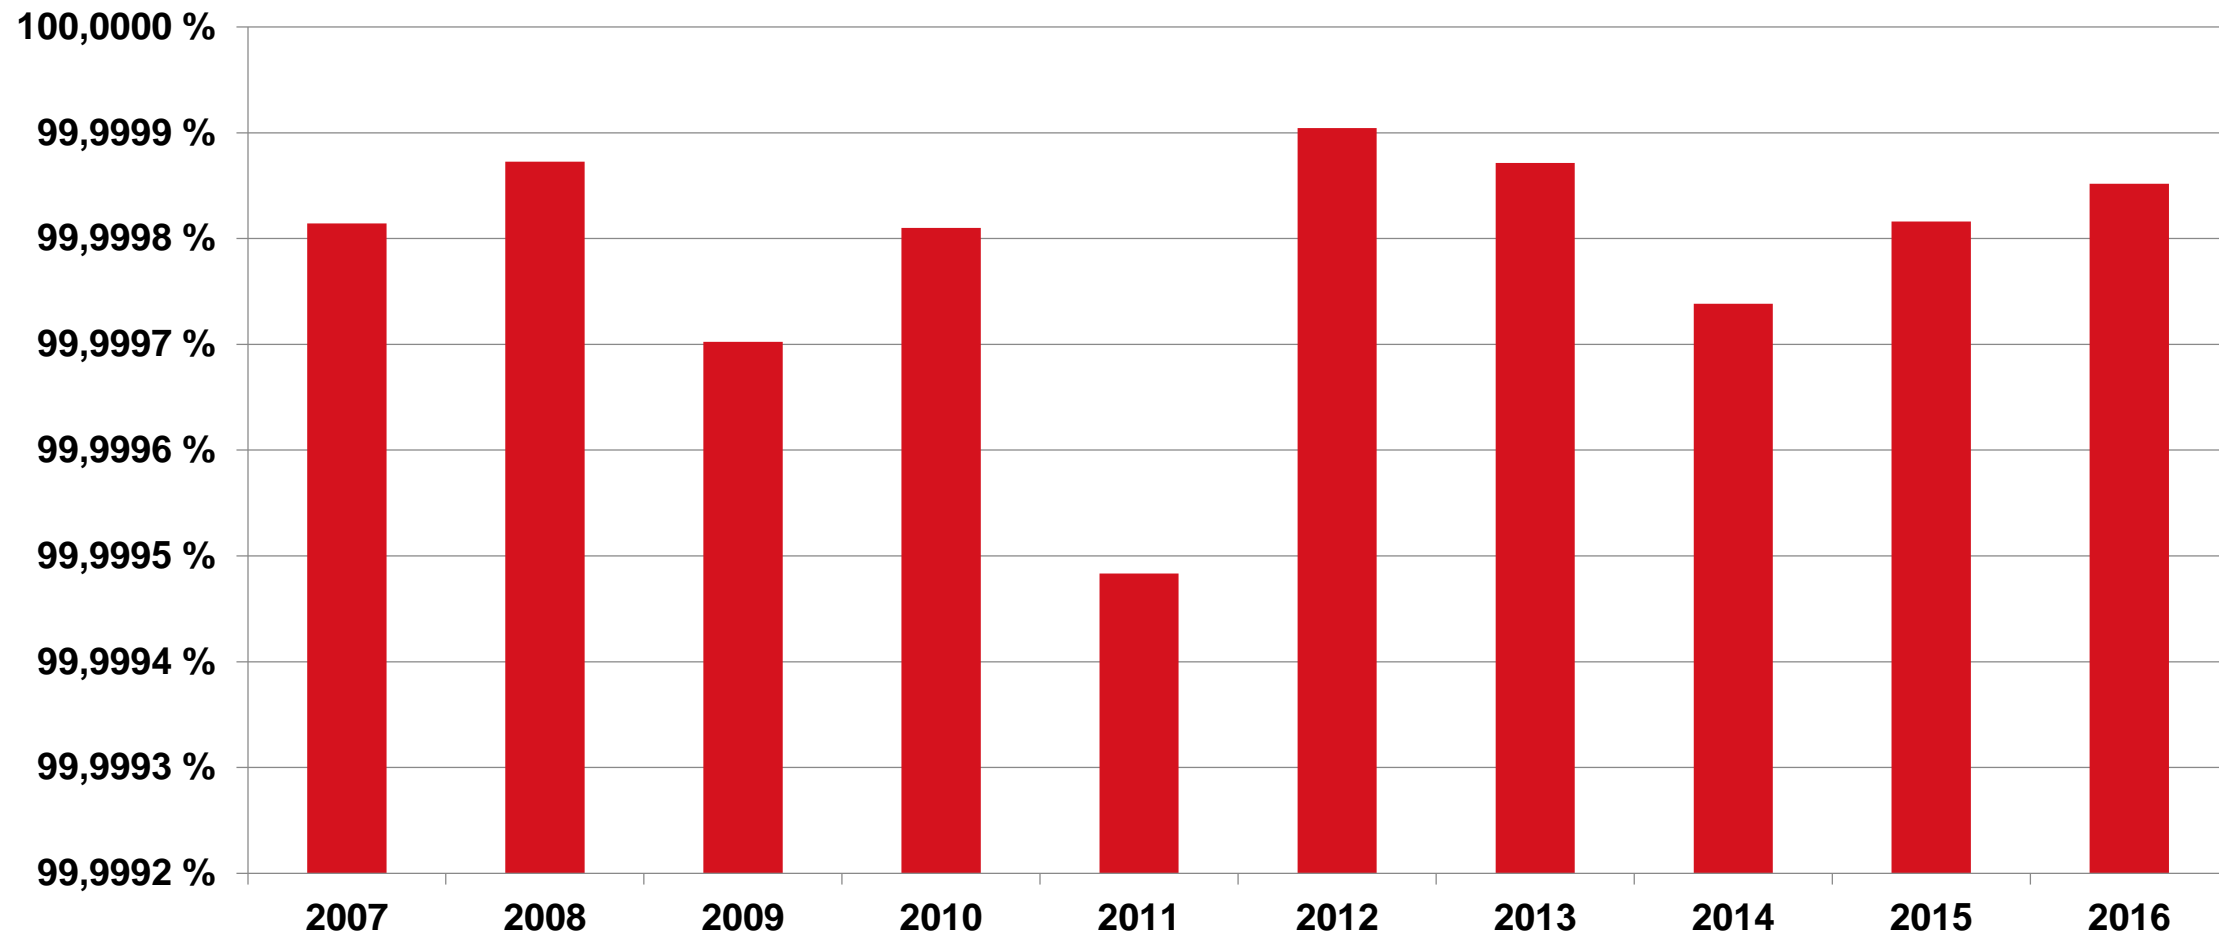

Energy Not Supplied (MWh) and KAH (M€)

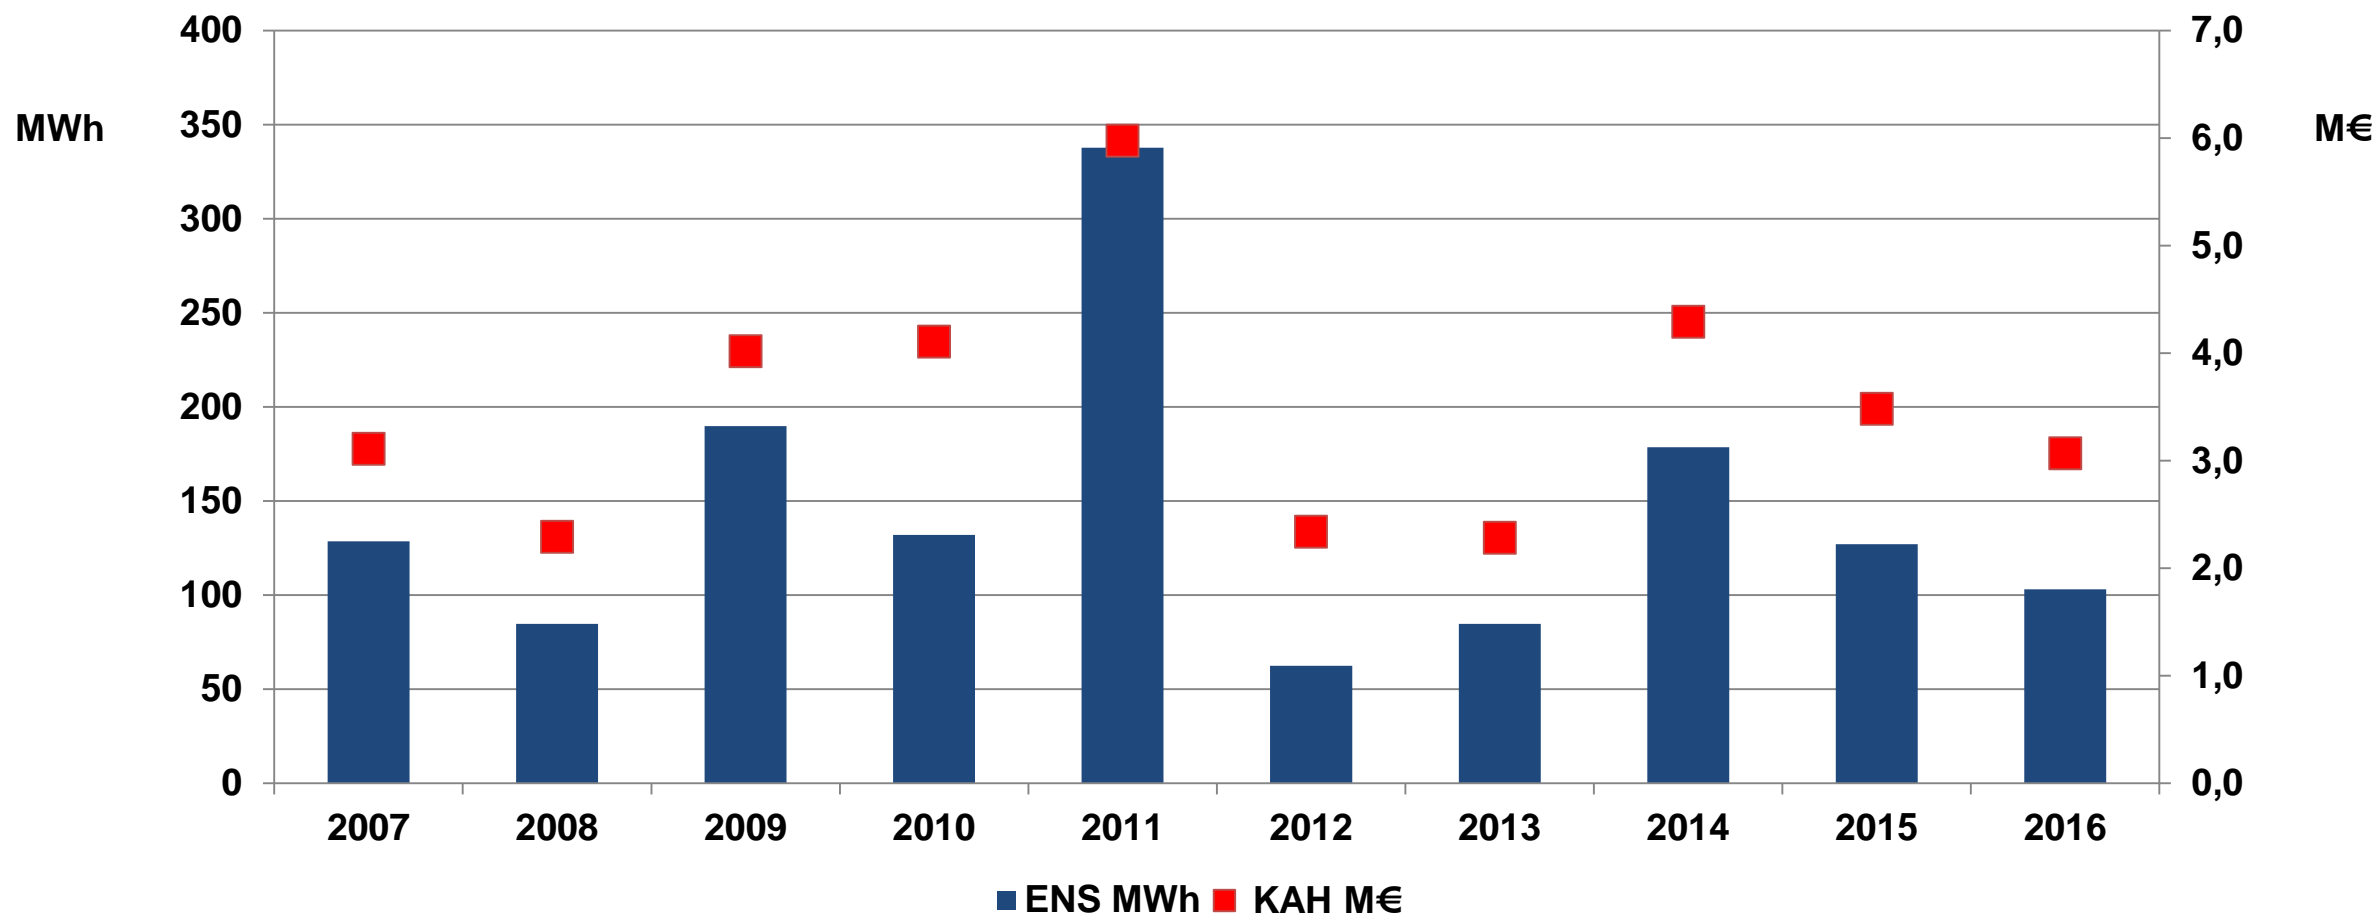

Connection point interruptions

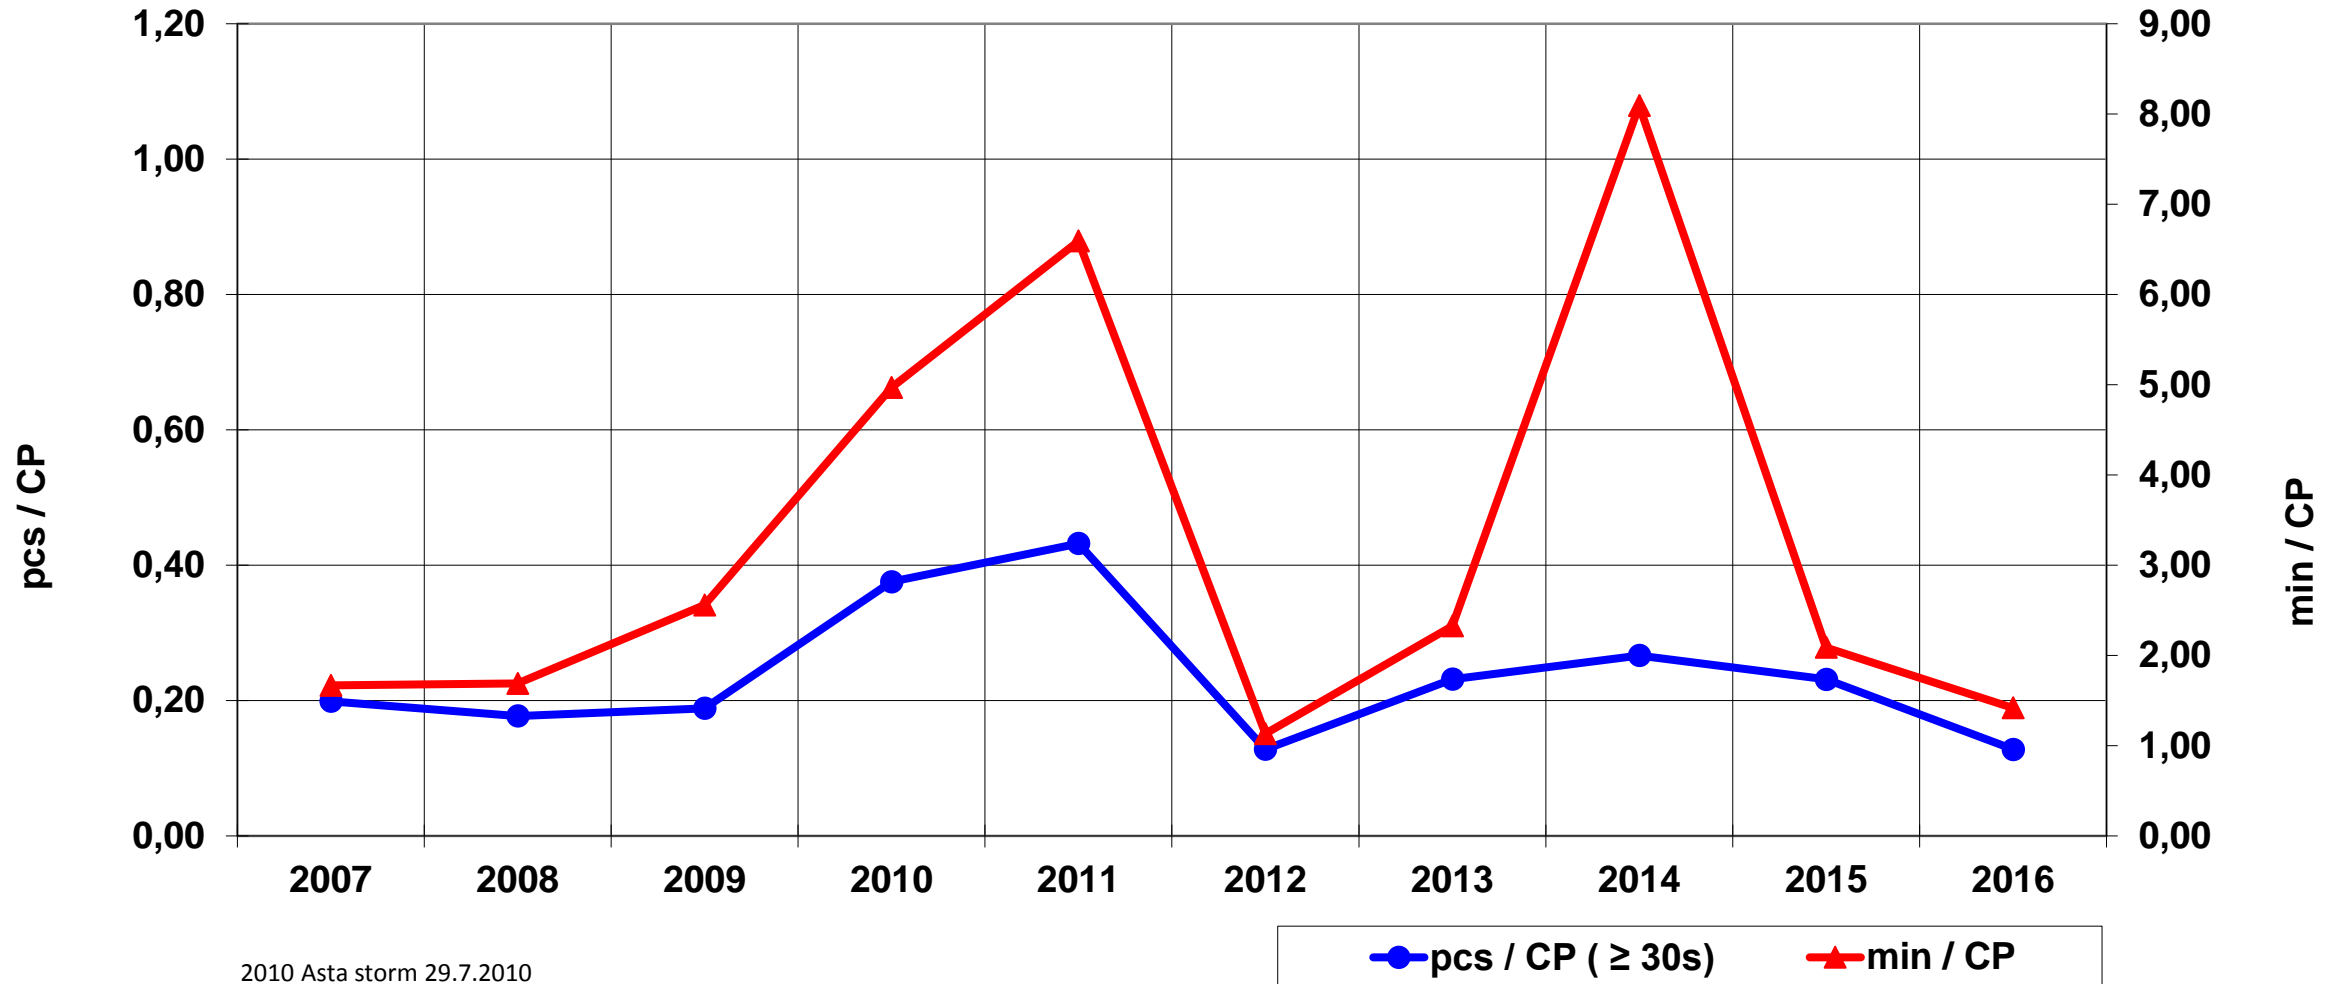

2010 Asta storm 29.7.2010

2011 Tapani and Hannu storms 26.-27.12.2011

2014 Felled tree on 110 kV line Hikiä-Forssa 24.3.2014, Circuit Breaker faults in Kainuu 28.7.2014

Number and reasons of disturbances

