



26.11. klo
13.00-14.55

**Webinaari
Kantaverkkopalvelun
reaaliaikatiedonvaihdesta
ja käytöstä vastaavan
toimijan ohjauksista**

26.11. klo 13.00-14.55

FINGRID

Ohjelma

13:00 Avaus, Laura Ihamäki

13:05 Miksi ohjattavuus ja näkyvyys ovat tärkeitä muuttuvassa sähköjärjestelmässä
kantaverkkokeskuksen silmin, Arto Pahkin

8.12.2025

13:15 Yhteenveto kaikkia laitoksia koskevista Kantaverkkopalveluehtojen ohjattavuuden ja tiedonvaihdon vaatimuksista sekä tulossa olevat muutokset Fingridin Reaaliaikaisen tiedonvaihdon sovellusohjeeseen, Joonas Mörsky

13:45 Mitä VJV2024 ja SJV2024 edellyttävät uusilta laitoksilta, Joonas Mörsky

14:00 Miten VJV ja SJV2024-laitosten tiedonvaihto otetaan käyttöön, Juha Korpio

14:10 Loissähkön sovellusohjeen muutokset, Onni Härmä

14:15 Käytöstä vastaavien toimijoiden puheenvuorot (á 5 min)

Caverion, Enerva, Rejlers, Smart Energia palvelut

14:35 Aikaa kysymyksille

14:55 Päätös

An aerial night view of a city, likely Helsinki, featuring a large Ferris wheel and various illuminated buildings. The text is overlaid in the center.


Why are Controllability and Visibility Important in a Changing Power System – From the Perspective of the Transmission System Control Center

Main Tasks of the Transmission System Control Center

For the power system, the system responsibility lies with Fingrid, which acts as the transmission system operator. Fingrid is responsible for the technical functionality, balance, and disturbance management of the electricity transmission system in accordance with the Electricity Market Act (588/2013)..



We monitor and control the transmission grid 24/7

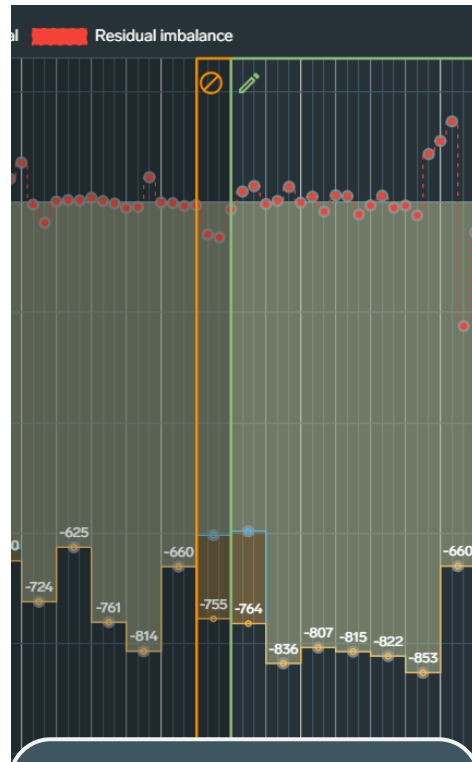


We keep electricity consumption and production in balance.



We implement transmission outages and anticipate operational situations



We prepare for and resolve disturbances quickly.

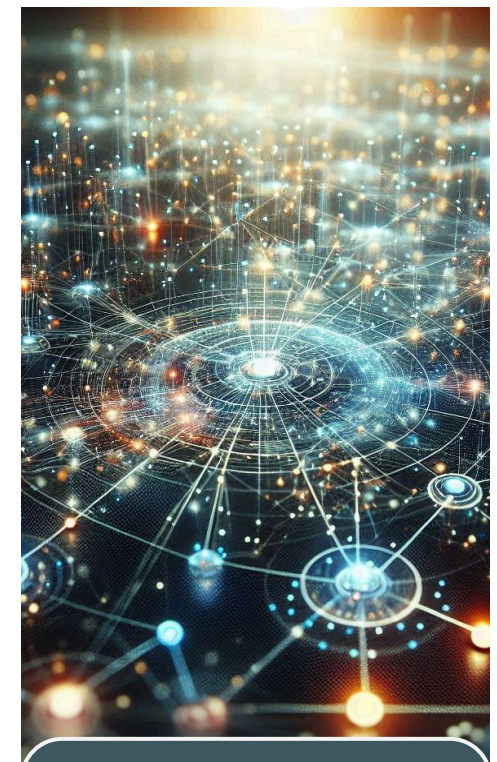


We monitor critical ICT systems and communication connections.

Power system in transition

Renewable production

Wind and solar power introduce new situations where real-time visibility becomes increasingly important.


- Especially during transmission outages and disturbances, two-way information exchange and real-time visibility from connected parties are needed (for example, “wind power output management,” “voltage control settings,” etc.).
- Situations develop rapidly, and traditional phone communication is too slow.
- The amount of production has increased sharply in recent years; in order to model and verify the behaviour of these resources, real-time data is required.

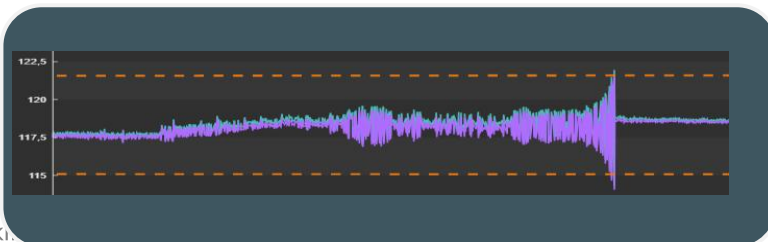

Methods for managing rapidly increasing changes in customer load

The change has been rapid, and in certain areas, transmission bottlenecks may occur.

- In cases of thermal overload, a network protection scheme can be built where the customer reduces or disconnects load quickly upon receiving a signal.
- If voltage stability is at risk, the customer is required to maintain a predetermined power limit at the connection point.
- Consumption is expected to grow in the coming years; in order to model and verify this behaviour, real-time data is required.

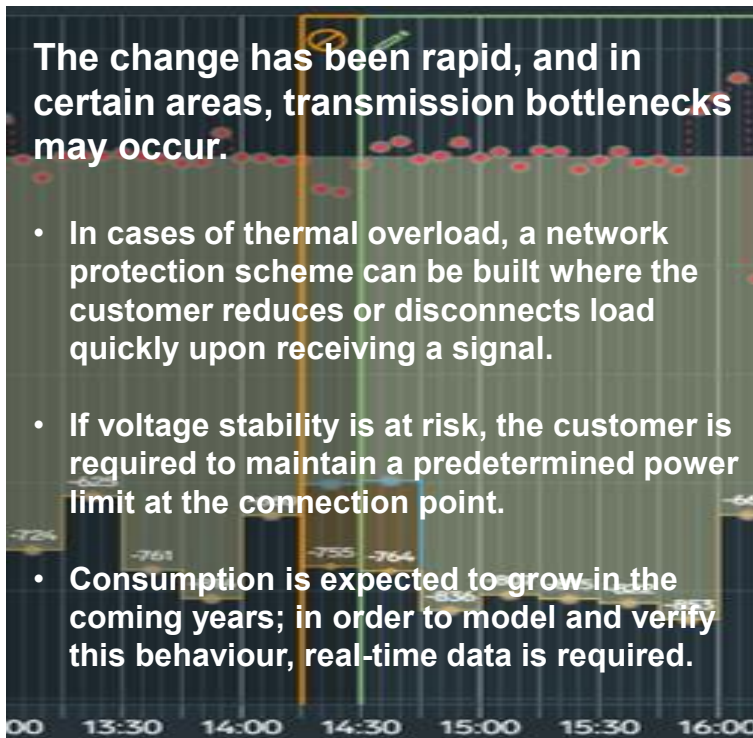

Forecasts provide reaction time for system management.

Forecast errors are inevitable.


Market participants' forecast errors can lead to significant balance deviations and market distortions.

In 2024, the largest balance deviations were in the thousands of MW.

Situations caused by forecast errors arise suddenly, and the exact duration is unknown; the maximum duration can be several hours.

Due to changed market and operational conditions, there is a recognized need to create a process for preventing and communicating significant balance errors alongside the electricity shortage process.

More accurate and actively updated forecast data from parties is needed.

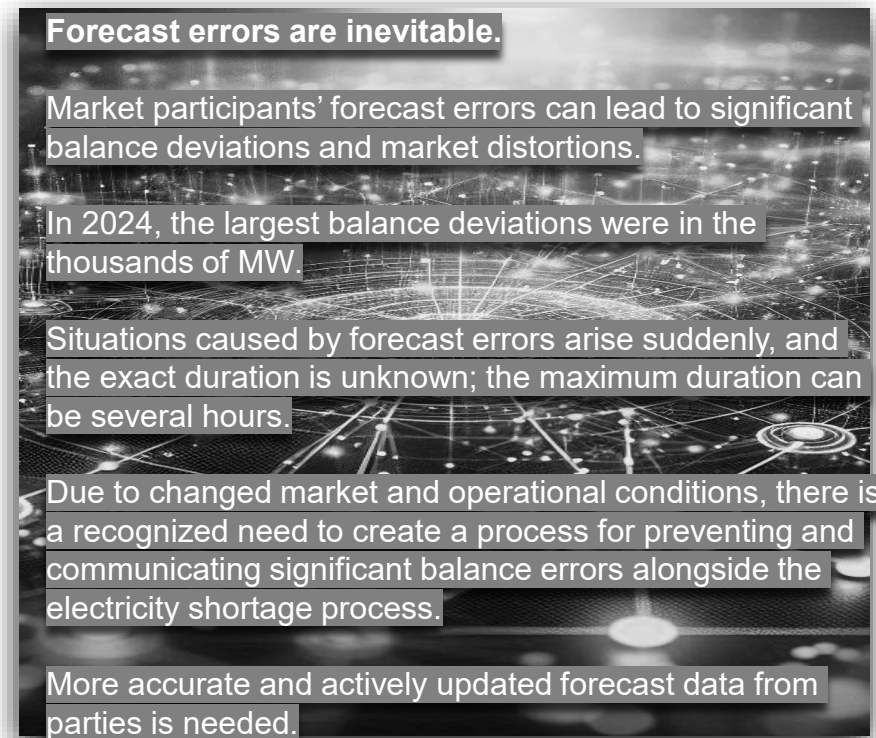




08/12/2025



Requirements for real-time signal exchange

FINGRID

Background

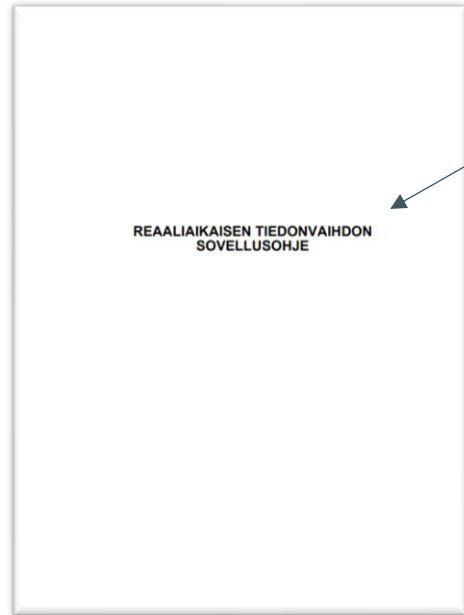

Implementation details of signal exchange

- REAL-TIME INFORMATION EXCHANGE is part of TERMS AND CONDITIONS OF THE MAIN GRID SERVICE KVPE2025
- Each network, powerplant, consumption or energy storage connected to Fingrid network needs to maintain requirements set by KVPE2025
- DSO connected powerplant, consumption or energy storage systems: DSO may handle some of the requirements or move the implementation responsibility to them their customers

Grid code specifications are part of KVPE terms but based on European legislation RFG, HVDC and DCC and latest only apply to changes done to assets and new assets

- VJV for Powerplants
- SJV for Energy storage systems
- KVJ for Consumption set
- HVDC for HVDC links

FINGRID		1 (151)
		15.1.2025
Voimalaitosten järjestelmälliset vaatimukset VJV2024		
Sisällysluettelo		
1	Johdanto	6
2	Termit ja määritelmät	7
3	Vaatimusten soveltamisala	11
4	Luottamuksellisuus	14
5	Erityistarkasteluvaatimukset	15
6	Vaatimusten todentamispöytäkirja, jatkuvaa seuranta ja niihin liittyvät vastuut	16
6.1	Vastuut, velvollisuudet ja oikeudet todentamispöytäkirjassa sekä jatkuvan seurannan aikana	16
6.1.1	Liittymisen ja liittymäseuran verkkonäkökulman vastuu, velvollisuudet ja oikeudet	16
6.1.2	Fingridin vastuu, velvollisuudet ja oikeudet	17
6.2	Voimalaitoksen järjestelmällisten ominaisuuksien muuttaminen	18
6.3	Vaihtelut etenevät voimalaitoshakkeet	18
6.4	Voimalaitoksen vaatimusten todentamispöytäkirja ja käyttöönottoilmoitusmenettely	18
6.4.1	Tyyppi A voimalaitoksen todentamispöytäkirja ja käyttöönottoilmoitusmenettely	18
6.4.2	Tyyppi B ja C voimalaitosten todentamispöytäkirja ja käyttöönottoilmoitusmenettely	19
6.4.3	Tyyppi D voimalaitoksen todentamispöytäkirja ja käyttöönottoilmoitusmenettely	20
7	Voimalaitostietojen dokumentointi ja toimittaminen	26
7.1	Tyyppi A voimalaitoksesta toimitettavat tiedot	26
7.2	Tyyppi B voimalaitoksesta toimitettavat tiedot	26
7.3	Tyyppi C voimalaitoksesta toimitettavat tiedot	28
7.4	Tyyppi D voimalaitoksesta toimitettavat tiedot	28
7.4.1	Voimalaitostietojen toimittaminen ja aikataulu	28
7.4.2	Toimitettavat tiedot	29
7.5	Tyyppi- ja tehdatakokeiden tiedot	34
8	Pöytäkirjat vaatimuksista	35
9	Reaaliaikaiset mittaukset, tiedonvaihto ja instrumentointi	36
9.1	Tyyppi A voimalaitoksen reaaliaikaiset mittaukset ja tiedonvaihto	36
9.2	Tyyppi B voimalaitoksen reaaliaikaiset mittaukset ja tiedonvaihto	36
9.3	Tyyppi C ja D voimalaitosten reaaliaikaiset mittaukset ja tiedonvaihto	36
9.4	Tyyppi C voimalaitosten instrumentointi	37
9.5	Tyyppi D voimalaitosten instrumentointi	38
10	Yleiset vaatimukset	40
10.1	Sähkölaitteiden jännitteet ja taajuuksien	40
10.2	Tyyppi A voimalaitoksen yleiset vaatimukset	40
10.2.1	Voimalaitoksen jännite- ja taajuusominaisuudet	40
10.2.2	Taajuuden muutosnopeuden sietokyky	40
10.2.3	Taajuusalkäily-ylijäätymisominaisuus (LFSS-O)	41
10.2.4	Päätösohjaus	42
10.2.5	Päätösohjausominaisuus sallittu alentaminen	42
10.2.6	Etäohjausominaisuus	42

KANTAVERKKOPALVELUEHDOT
KVPE2025

Lite 1

FINGRID

Sort list of terms used in this presentation

- RO, Relevant operator (= Käytöstä vastaava toimija)
- DSO, Distribution system operator (= Jakeluverkko)
- IBR, Inverter based resources (= Suuntaaja kytketty, esim tuulivoimala, aurinkovoimala, sähkövarasto)
- VJV = Grid code specifications for power generating facilities
- SJV = Grid code specifications for grid energy storage systems
- KJV = Grid code specifications for demand connections
- NC-ER = European Network code for Emergency and Restoration

Types of powerplants and energy storage systems

Table 3.1. The power-generating facility's type classification based on rated capacity and the connection point's voltage level.

Type category	Connection point's voltage level	Term /condition	Power-generating facility's rated capacity $P_{\max}$
Type A	The connection point's voltage level is less than 110 kV ¹	and (*)	The power-generating facility's rated capacity is at least 0.8 kW but less than 1 MW. ($0.8 \text{ kW} \leq P_{\max} < 1 \text{ MW}$)
Type B	The connection point's voltage level is less than 110 kV ¹	and (*)	The power-generating facility's rated capacity is at least 1 MW but less than 10 MW. ($1 \text{ MW} \leq P_{\max} < 10 \text{ MW}$)
Type C	The connection point's voltage level is less than 110 kV	and (*)	The power-generating facility's rated capacity is at least 10 MW but less than 30 MW. ($10 \text{ MW} \leq P_{\max} < 30 \text{ MW}$)
Type D	The connection point's voltage level is at least 110 kV	or (+)	The power-generating facility's rated capacity is at least 30 MW ($P_{\max} \geq 30 \text{ MW}$)

Relevant operator (RO, KVT in Finnish)

The entity appointed by and representing the power-generating facility owner. The RO is responsible for the operation of the power generating facility in the electricity network. At all times, the RO must know the operating state of the power-generating facility and have the right and possibility to control the power-generating facility and change its operating point and control mode and authorize or limit any controls issued outside the power-generating facility.

In Finnish, KVT stands for: Käytöstä Vastaava Toimija



08/12/2025

FINGRID

Relevant Operator (KVT in Finnish)

- 24/7/365 contact for Fingrid for powerplant or energy storage system
 - Any control needs are requested from relevant operator
 - DSO connected systems, if RO information is not available, contact will be done to DSO control room
 - Remember to maintain contact information to Fingrid
 - Have knowledge of state of powerplant or energy storage system
 - Disturbance records will be requested from relevant operator
 - Will fetch the recordings from the plant systems or forwards the request
- VJV/SJV2024
 - Can take over external controls, Example market operations

Relevant operator (RO, KVT in Finnish)

Grid code	Type B OR 1... 9.99 MW	Type C & D OR over 10.0 MW or Direct Fingrid Connection
VJV2013	DSO set rules	YES
VJV2018 or SJV2019	DSO set rules	YES
VJV2024 or SJV2024	YES	YES



FINGRID

Image: Google Gemini 2.5 Flash

Controls for powerplants (Inverter based resources)

Grid code	Nominal power (type of plant)	Stopping and starting + Disconnection from grid	Active power control + Fast Power limit (for converters)	U-mode Setpoints up + down	Q-mode Cosp-mode + setpoints up + down, inductive + capacitive	VJV2024 Table 10.1 and 10.2 controls
VJV2013 or older	1.00 MW ... 9.99 MW	DSO will set the rules				
VJV2013 or older	Over 10MW	X	Active power control	X	X	
VJV2018	Type B	DSO will set the rules				
VJV2018	Type C & D	X	X	X	X	
VJV2024	Type B	DSO will set the rules				
VJV2024	Type C & D	X	X	X	X	X



Image: Google Gemini 2.5 Flash

Controls for energy storage systems

Grid code	Nominal power (type of plant)	Stopping and starting + Disconnection from grid	Active power control and limiting	U-mode Setpoints up + down	Q-mode Cosp-mode + setpoints up + down, inductive + capacitive	SJV2024 Table 10.1 and 10.2 controls
SJV2019	Type B	DSO will set the rules				
SJV2019	Type C & D	X	X	X	X	
SJV2024	Type B	DSO will set the rules				
SJV2024	Type C & D	X	X	X	X	X



Image: Google Gemini 2.5 Flash

Realtime signal exchange powerplants, Inverter based resources

Generation type	Grid code	Nominal power (type of plant)	Active power + Reactive power + Breaker + Over 10MVar capacitor bank breaker	U-mode Q-mode Voltage*	Request Fingrid -> KVT (Plim,U,Q) signals **	VJV2024 Table 10.1 and 10.2 signals ***
Converter	Before VJV2018	1.00 MW ... 9.99 MW	X			
Converter	Before VJV2018	Over 10MW	X	X	X	
Converter	VJV2018	Type B	X			
Converter	VJV2018	Type C & D	X	X	X	
Converter	VJV2024	Type B	X			
Converter	VJV2024	Type C & D	X	X	X	X

*) Signals indicate (power plant → Fingrid)

- System at constant reactive power mode
- System at constant voltage control mode
- Voltage used for constant voltage control reference

**) Signals over the ICCP or ELCOM to indicate (Fingrid → RO)

- Request for active power limit
- Request for constant voltage control mode
- Request for constant reactive power mode

***See interface description from document "VJV2024 and SJV2024 relevant operator real-time signal exchange"

References: VJV2024, VJV2018, KVPE2025, real-time signal exchange 2026

NOTE!

table doesn't include reserve market signals as they are market specific.



Realtime signal exchange powerplants, synchronous machine

Generation type	Grid code	Nominal power (type of plant)	Active power + Reactive power + Breaker	U-mode Q-mode Voltage*	Request Fingrid -> KVT (Plim,U,Q) signals **	VJV2024 Table 10.1 and 10.2 signals ***
Synchronous machine	Before VJV2018	Over 1 MW	X			
Synchronous machine	VJV2018	Type B, C and D	X			
Synchronous machine	VJV2024	Type B	X			
Synchronous machine	VJV2024	Type C & D	X	X	X	X

- *) Signals indicate (power plant → Fingrid)

 - System at constant reactive power mode
 - System at constant voltage control mode
 - Voltage used for constant voltage control reference
- **) Signals over the ICCP or ELCOM to indicate (Fingrid → RO)

 - Request for active power limit
 - Request for constant voltage control mode
 - Request for constant reactive power mode

***See interface description from document "VJV2024 and SJV2024 relevant operator real-time signal exchange"



Realtime signal exchange energy storage systems

Grid code	Nominal power (type of plant)	Active power + Reactive power + Breaker	U-mode* Q-mode Voltage*	Request Fingrid -> KVT (Plim,U, Q) signals**	SJV2024 Table 10.1 and 10.2 signals ***
SJV2019	Type B	X			
SJV2019	Type C & D	X	X	X	
SJV2024	Type B	X			
SJV2024	Type C & D	X	X	X	X

- *) Signals indicate (Energy storage system → Fingrid)
- System at constant reactive power mode
 - System at constant voltage control mode
 - Voltage used for constant voltage control reference

- **) Signals over the ICCP or ELCOM to indicate (Fingrid → RO)
- Request for active power limit
 - Request for constant voltage control mode
 - Request for constant reactive power mode

References: SJV2024, SJV2019, KVPE2025,
real-time signal exchange 2026

***See interface description from
document "VJV2024 and SJV2024
relevant operator real-time signal
exchange"

NOTE!

table don't include reserve market signals. They are market specific



Image: Google Gemini 2.5 Flash

Realtime signal exchange, consumption


Grid code	Nominal power (type of plant)	Active power	Reactive power*	Switchgear status	Compensation equipment status*
<u>Datacenter*</u> , Electric boiler, Heatpump	Over 1 MW	X	X		Over 10MVar or 110kV
<u>Datacenter*</u> , Electric boiler, Heatpump	Over 10 MW	X	X	Aggreed separetly	Over 10MVar or 110kV
Industrial consumption, charging statation	Under 10 MW	X	X	Aggreed separetly	Over 10MVar or 110kV
Industrial consumption, <u>charging statation*</u>	Over 10 MW	X	X	Aggreed separetly	Over 10MVar or 110kV

*) New additions to real-time signal exchange 2026
Compared to real-time signal exchange 2024

References: KVPE2025,
real-time signal exchange 2026

Julkinen

NOTE!
table don't include reserve market signals. They are market specific

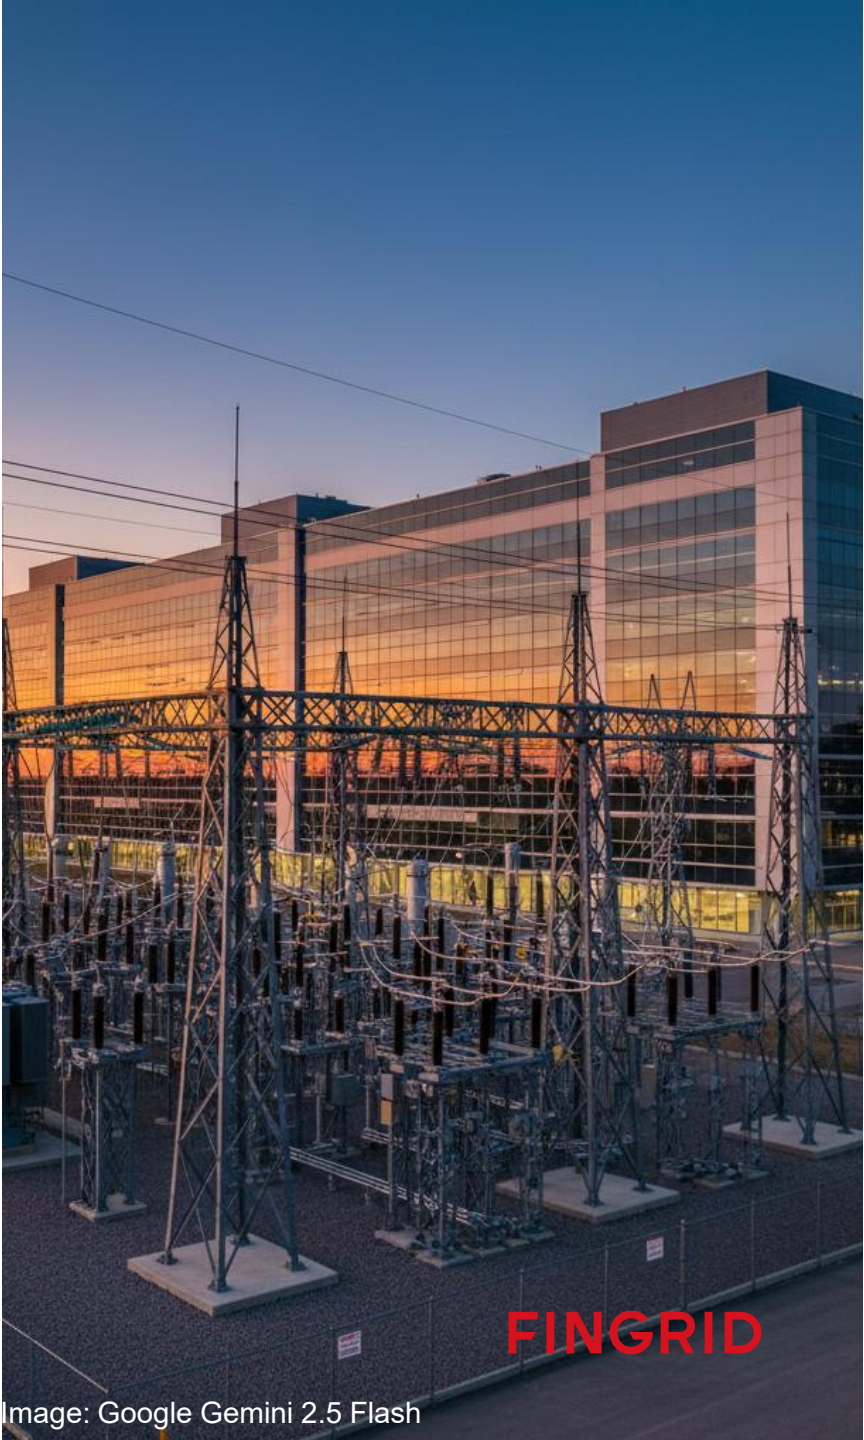

FINGRID

Image: Google Gemini 2.5 Flash

Realtime signal exchange, distribution networks

- Relevant switchgear status and measurements (mainly 110kV)
 - Ask details from reaaliaikatiedonvaihto@fingrid.fi
- Status and control mode of 110kV or over 10MVAR reactive power compensation equipment



Data connections and protocols

Grid code	RTLITE (REST API over internet)	Requirement for 24h operation capability during outages	FEN-network	KOVA FEN
Under 1MW powerplant, energy storage system that participates on market	YES, if connected to DSO network	YES, If connected directly to Fingrid network, Not required from DSO connected assets	YES IEC104 or ICCP	YES IEC104 or ICCP
1MW...9,99MW powerplant, energy storage system	YES, if connected to DSO network	YES, If connected directly to Fingrid network, Not required from DSO connected assets	YES IEC104 or ICCP	YES IEC104 or ICCP
10MW...30MW powerplant, energy storage system	No	No	YES ICCP	YES ICCP
Over 30MW powerplant, energy storage system or consumption unit or any other with direct Fingrid connection	No	YES	No	YES ICCP



Fault recordings

FINGRID

Reporting responsibility

- Powerplant or energy storage system owner have a responsibility to report events when system does not fulfil grid code specifications
 - VJV2013 Chapter 5.1.1
 - VJV2018, VJV2024 Chapter 6.1.1
 - SJV2019, SJV2024 Chapter 6.1.1
- Fault and swing recorders should be time synced with 200ms accuracy
- **Example of events to report (C&D type or over 10MW system):**
 - Power plant or energy storage system trips due to grid disturbance
 - Islanding event occurred
 - Fault in reactive or active power control
 - Unstable behaviour
 - Power plant or energy storage system have limited reactive power capacity, for example, broken cap bank
- **Example of events to report (B type or system with 1.0 ... 9.99 MW system):**
 - DSO set the rules and reporting routes in general
 - Report to Fingrid voimalaitostiedot@fingrid.fi withing 1 week of event in following conditions:
 - Unstable behaviour
 - Power plant or energy storage system trips due to grid disturbance against fault ride thru requirements



Image: Google Gemini 2.5 Flash

FINGRID

Delivering fault recordings to Fingrid

- Include the email report
 - Power plant or energy storage system name and substation name
 - Sort description of event
 - Fault recording of event, max +/-2min from event
 - Sampling requirements set by VJV/SJV, if not stated, deliverer best data available
 - Preferred formats: COMTRADE, CSV
 - List of events from SCADA or from protection relays
 - CSV, EXCEL, TXT, max +/-2min from event
 - Setpoints before events
 - Active power setpoint
 - Reactive power controller mode and setpoints
 - Constant voltage control (U-mode)
 - Constant reactive power (Q-mode)
 - Constant power factor mode (cosp-mode)

Reports should be sent Fingrid to email address voimalaitostiedot@fingrid.fi within 1 week of the event

FINGRID



08/12/2025




VJV2024 and SJV2024 new signal requirements


FINGRID

Background

- ONLY APPLY POWERPLANTS AND BESS BUILD WITH SJV2024 or VJV2024
- VJV2024 and SJV2024 chapter 10.4.1 and tables 10.1 and 10.2 set new signal and control requirements for powerplants and energy storage systems of type C&D
- Implementation details of signals between RO and Fingrid can be found from document “VJV2024 ja SJV2024 mukainen käytöstä vastaavan toimijan reaaliaikainen tiedonvaihto”
 - Note that signals between RO and powerplant / energy storage system are part of project design
- Signals doesn't move operation responsibility of powerplant or energy storage system from Relevant operator to Fingrid
- Signals are only used in emergencies

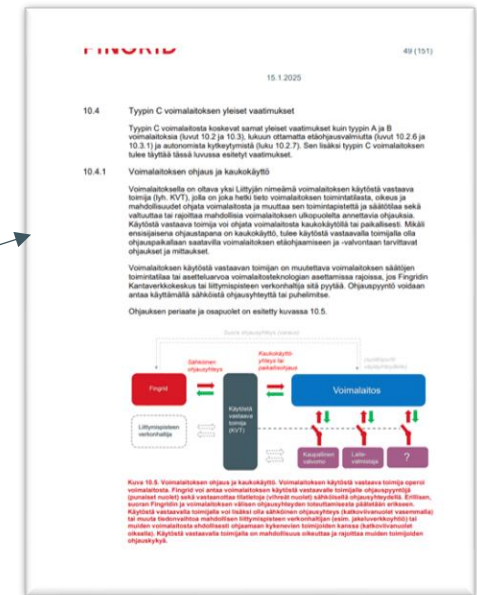


Signal flows and relevant manuals (C&D type)

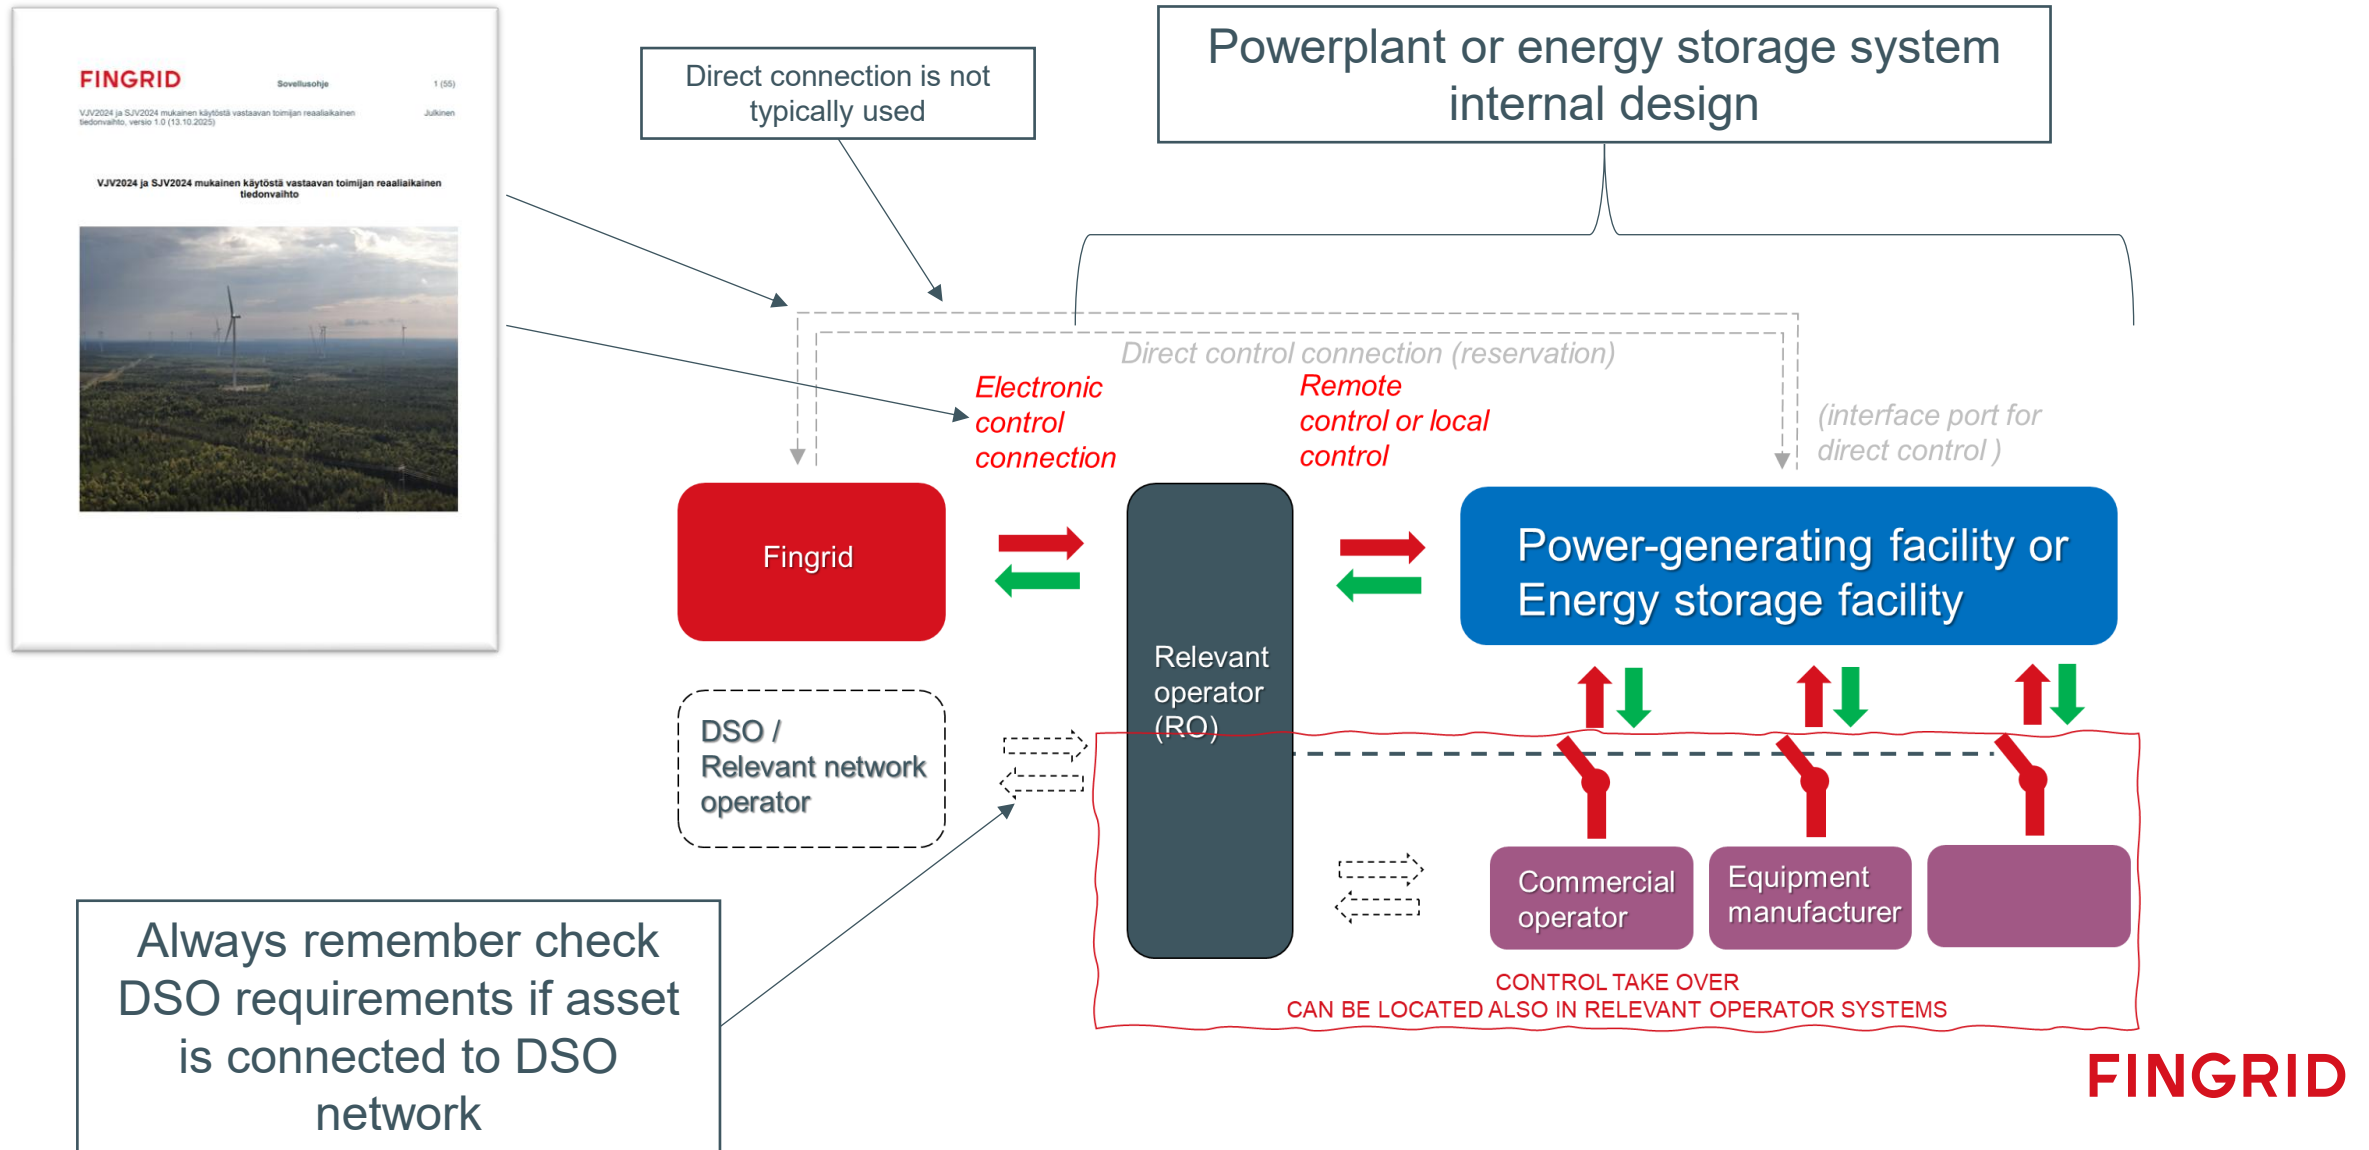


VJV/SJV2024 requires ramps to be used in controls

- SJV2024 and VJV2024 have ramp rates defined
- Important to note that these ramps need to be implemented some point of signal chain, Powerplant controller / SCADA or in RO SCADA systems

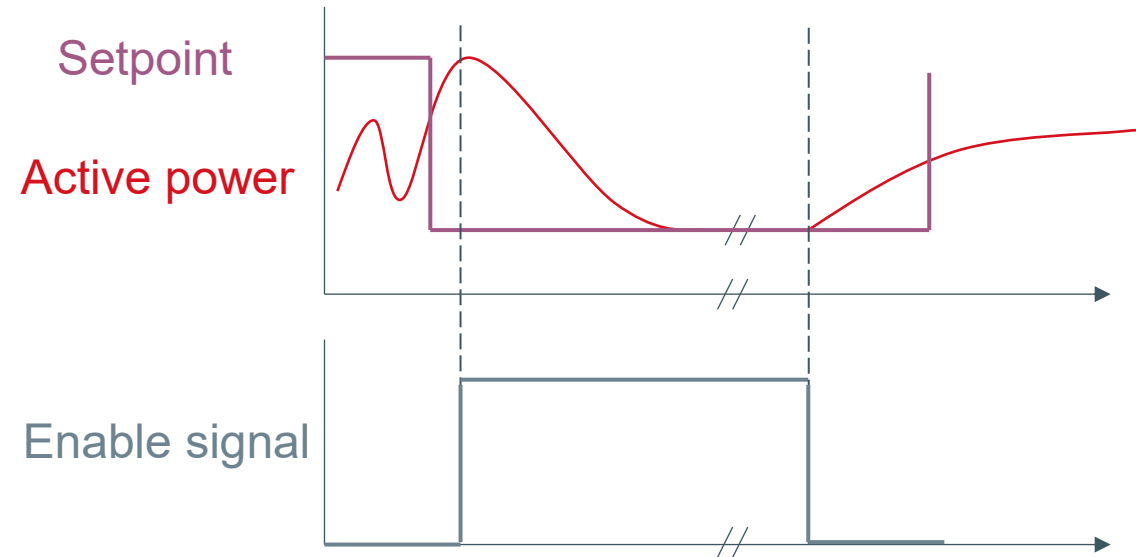

VJV2024 and SJV2024 RO control take over

- **Example 1:** A facility designated as a significant network user loses normal communication connections due to a disturbance in the distribution network or the telecommunications network. Before the disturbance, the facility had been shut down due to market-based controls. The Relevant operator (KVT) is able to take control of the facility using connections with 24-hour operational capability (NC-ER) and restore the facility to production according to the original production plan.
- **Example 2:** A disturbance occurs in the facility's market control system, and the facility begins to behave unstably. The Relevant Operator (KVT) is able to prevent automatic market control during the fault investigation.
- **Example 3:** A fault occurs in the electrical network supplying the facility, and due to backup route used after fault for feeding, the facility must be set to a power limit. Under Relevant operator (KVT) control, it must be possible to restrict market controls or commissioning test runs so that network capacity is not exceeded during backup feed route.

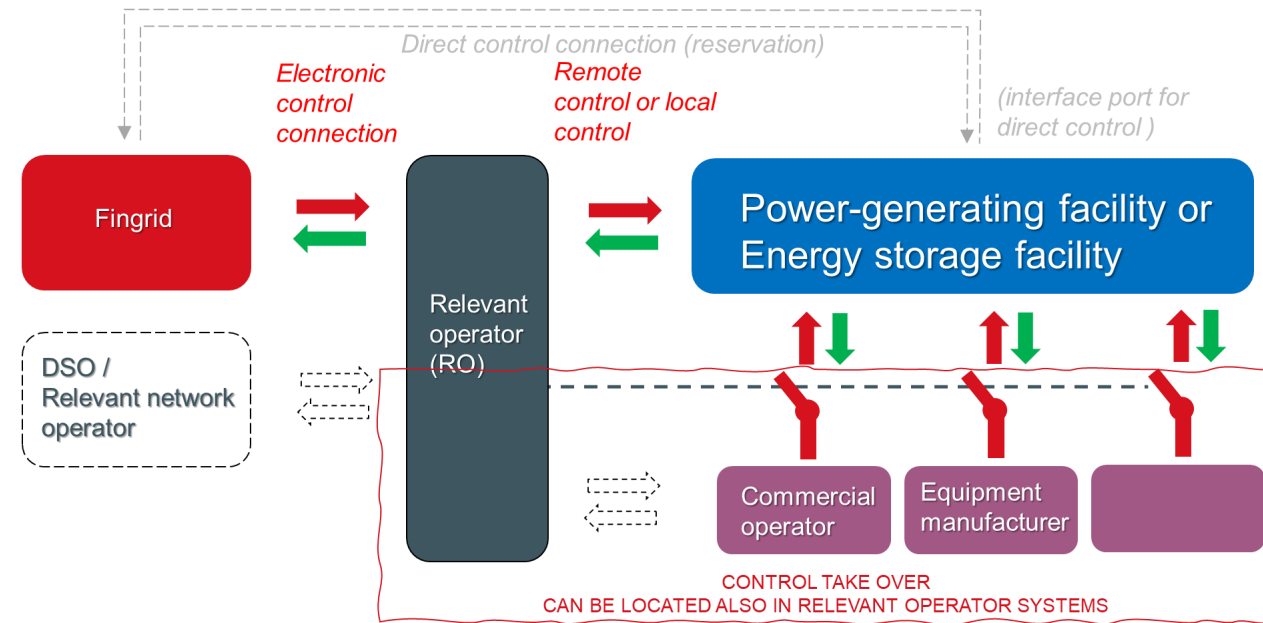

FINGRID




26.11.2025




VJV/SJV2024 Real-time Signal Commissioning Process

FINGRID

Real-time signal exchange VJV2024 or SJV2024, Type C or D

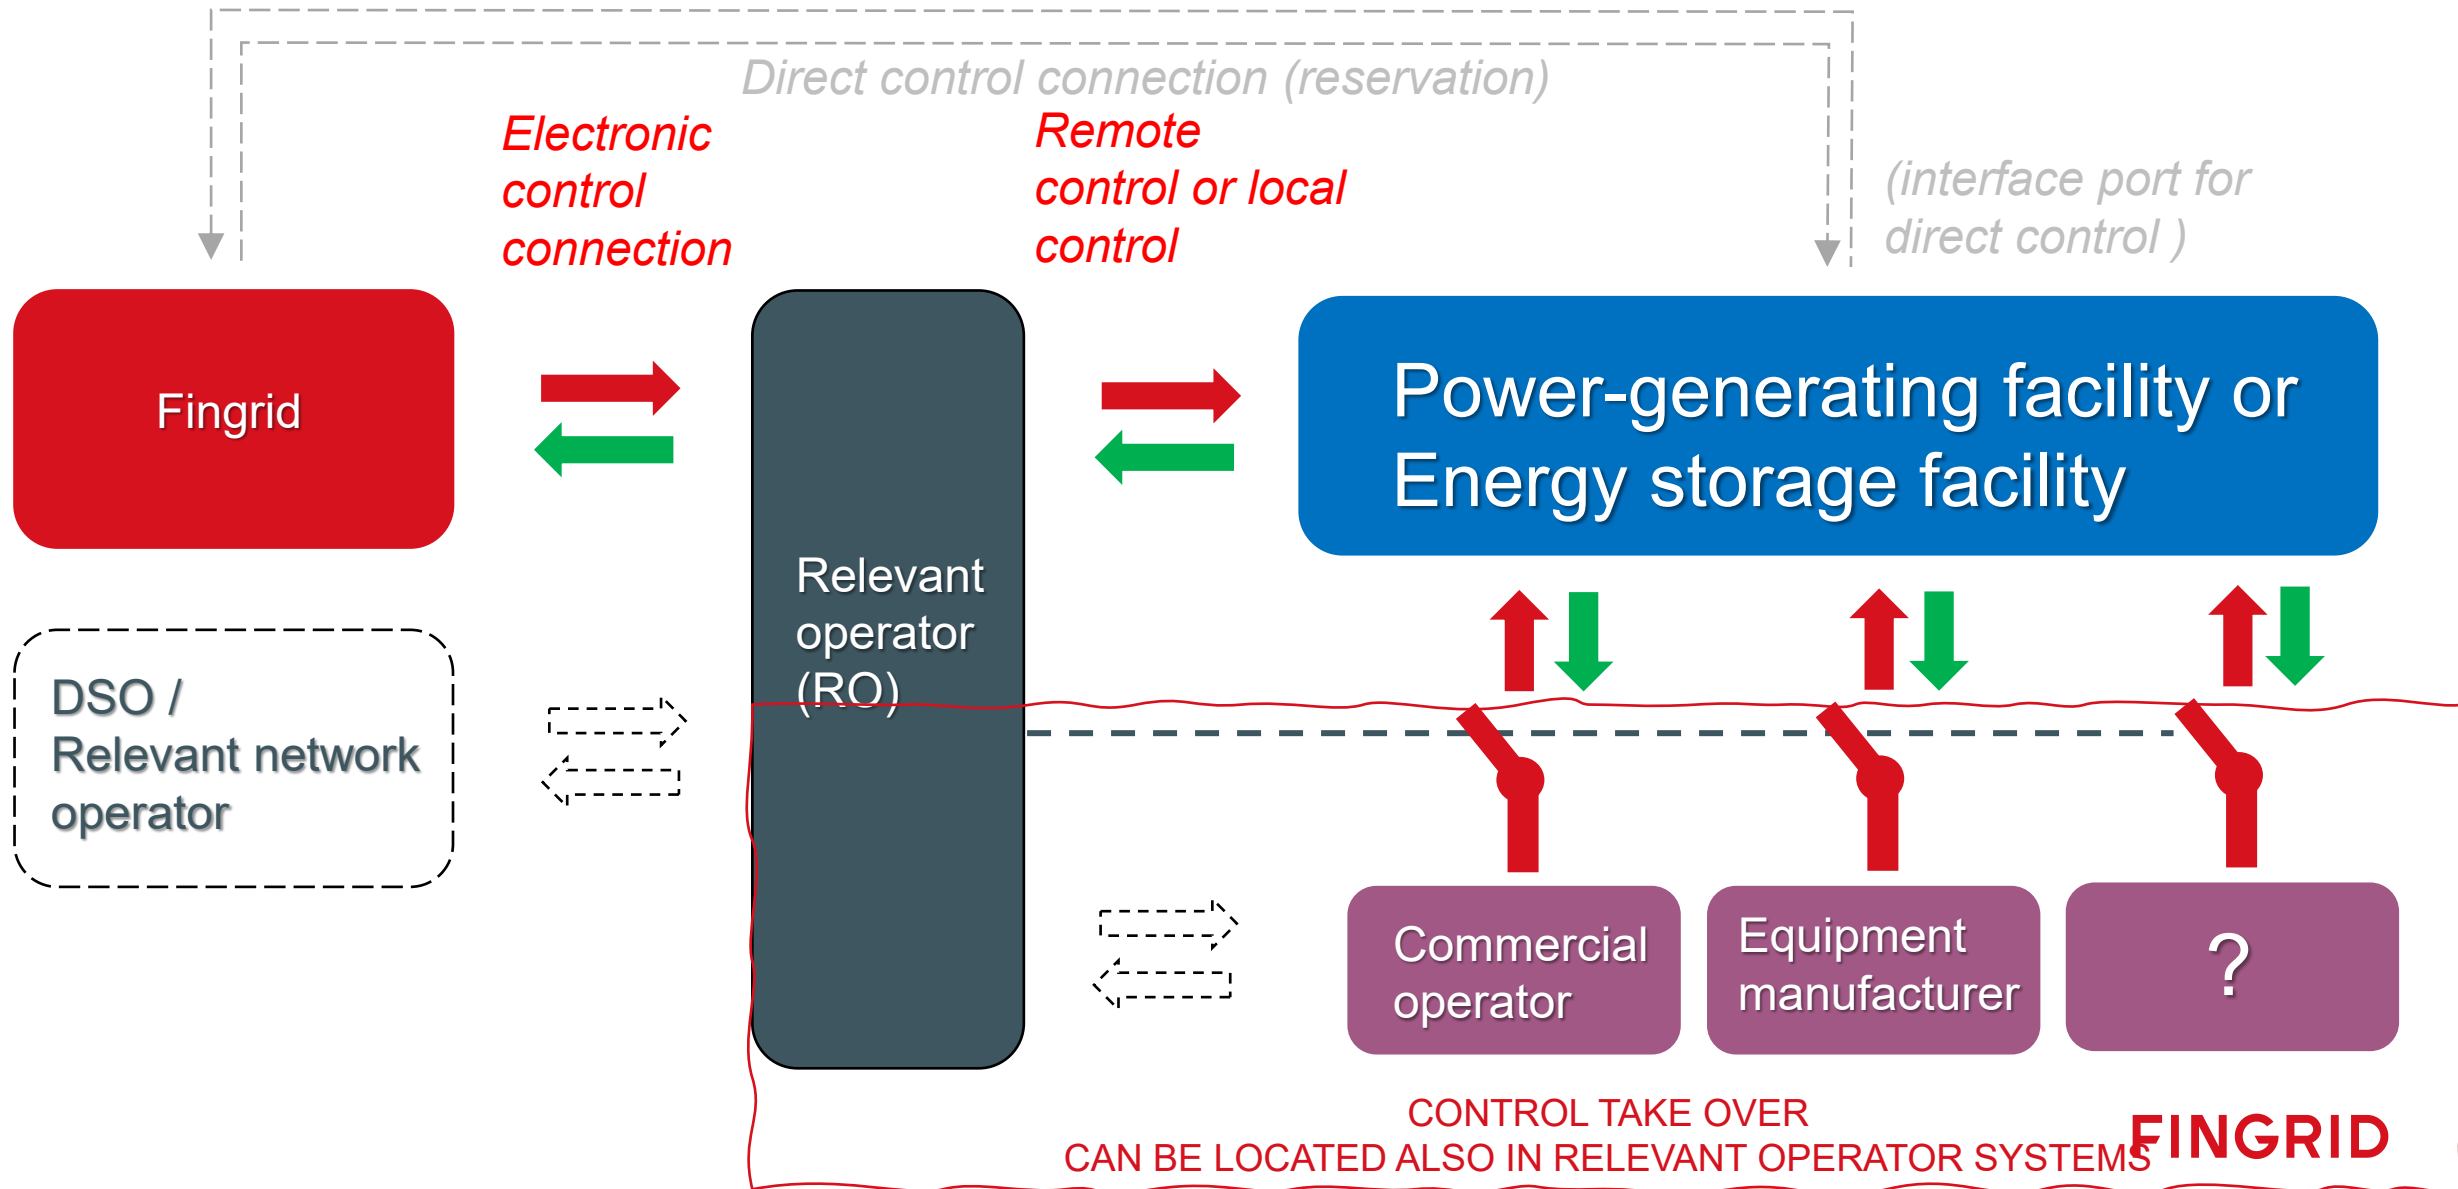

Real-time signal exchange VJV2024 or SJV2024, Type C or D

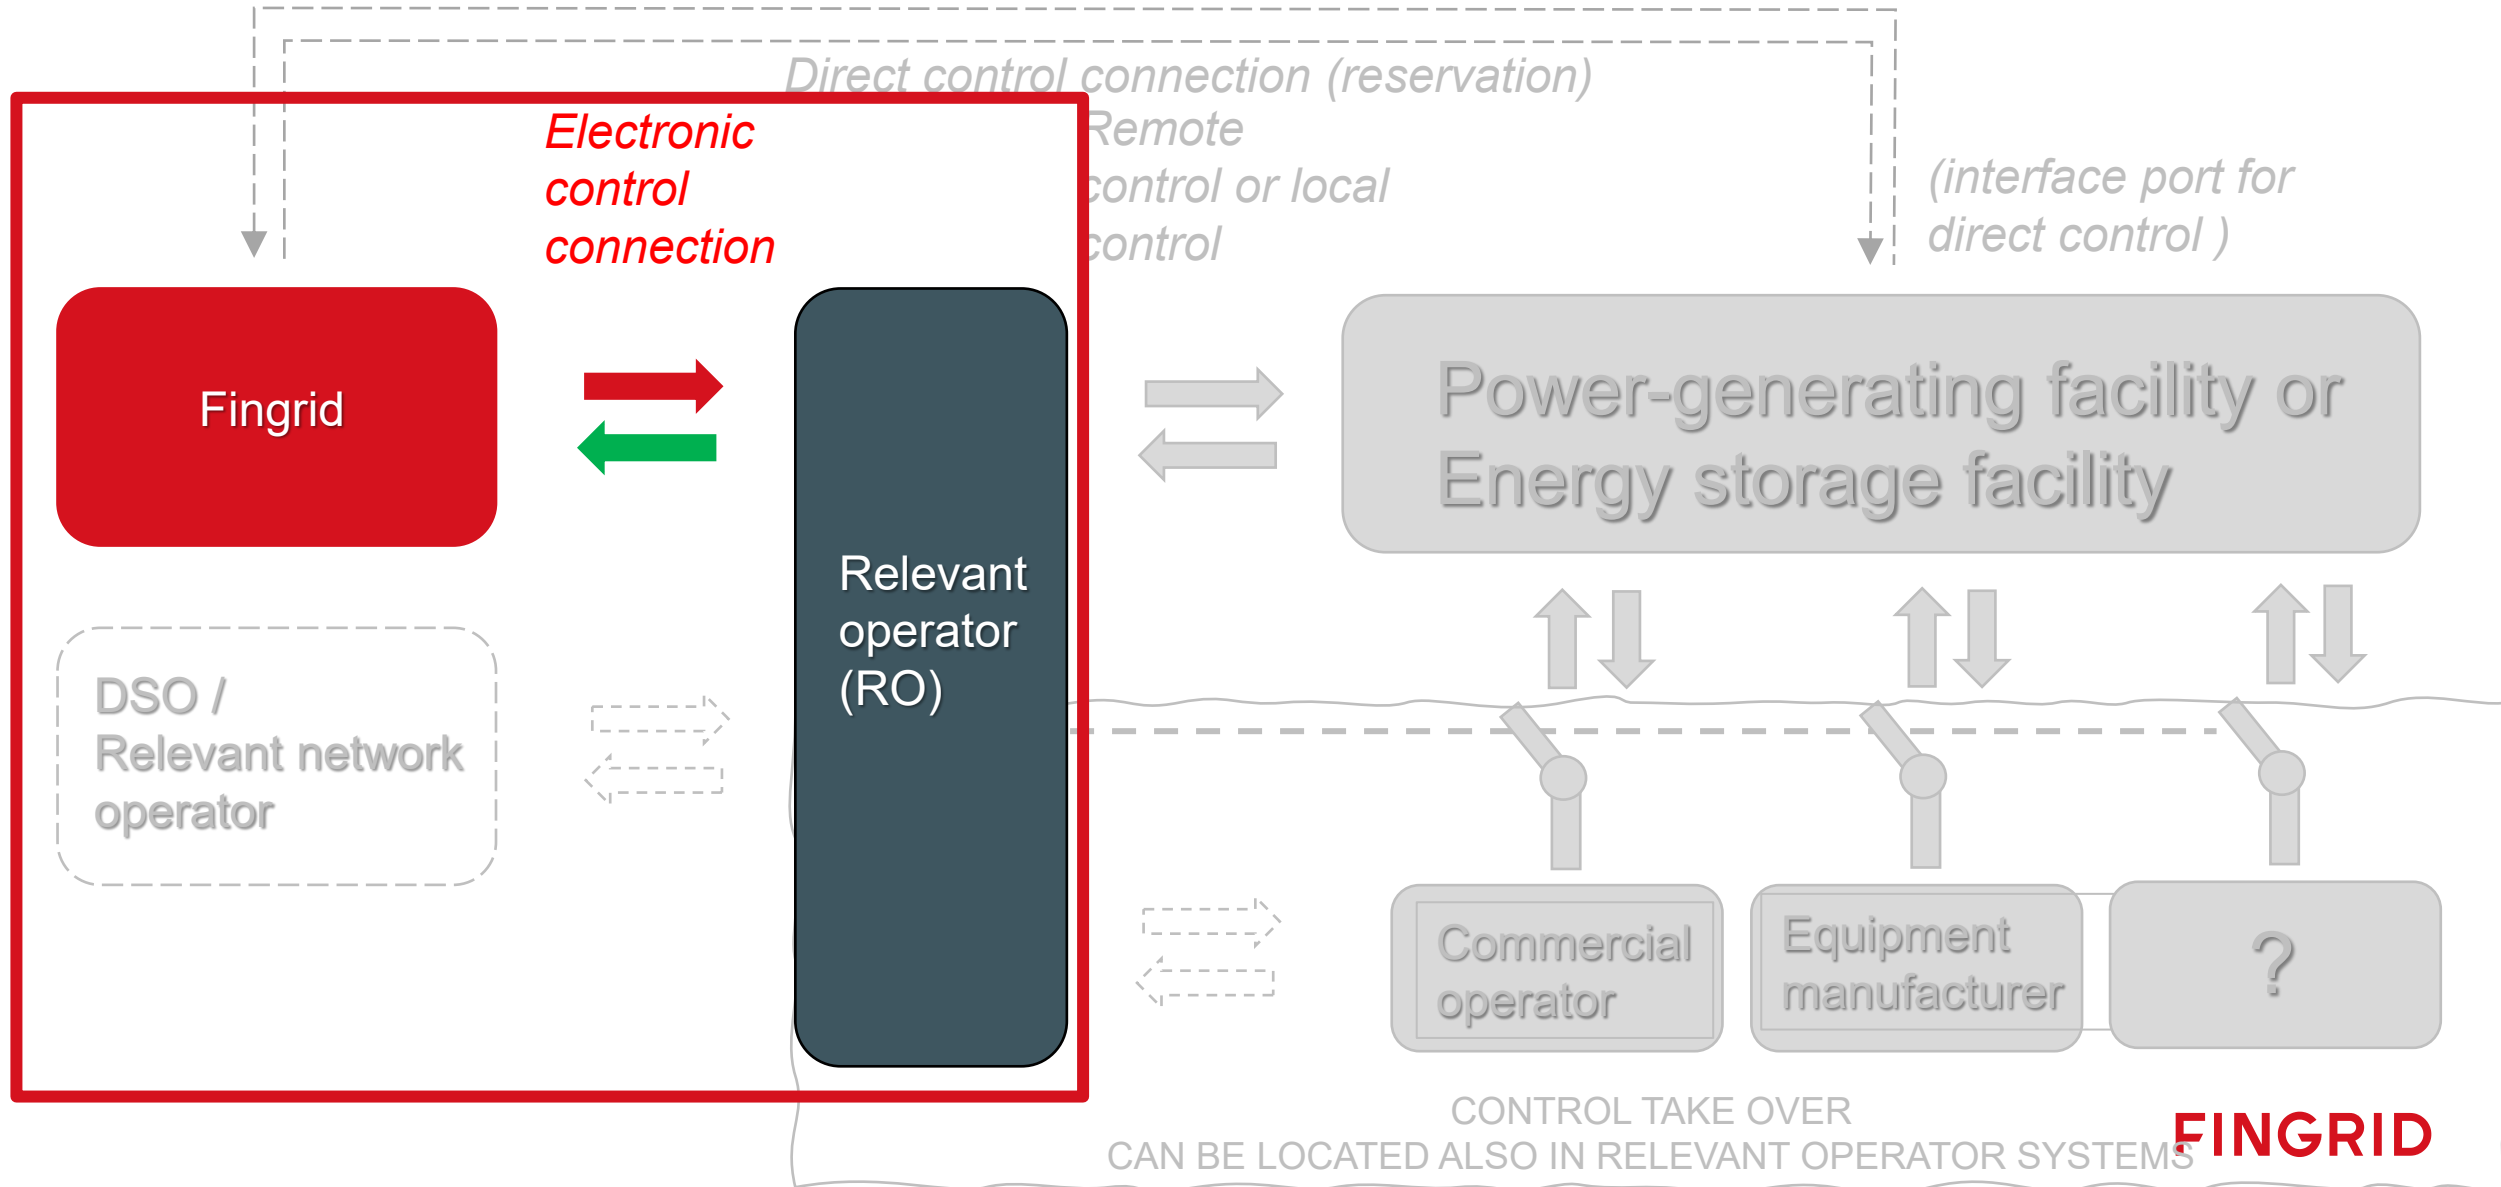


Real-time Signal Commissioning Process

6 months

2 months

1 month

Production
start

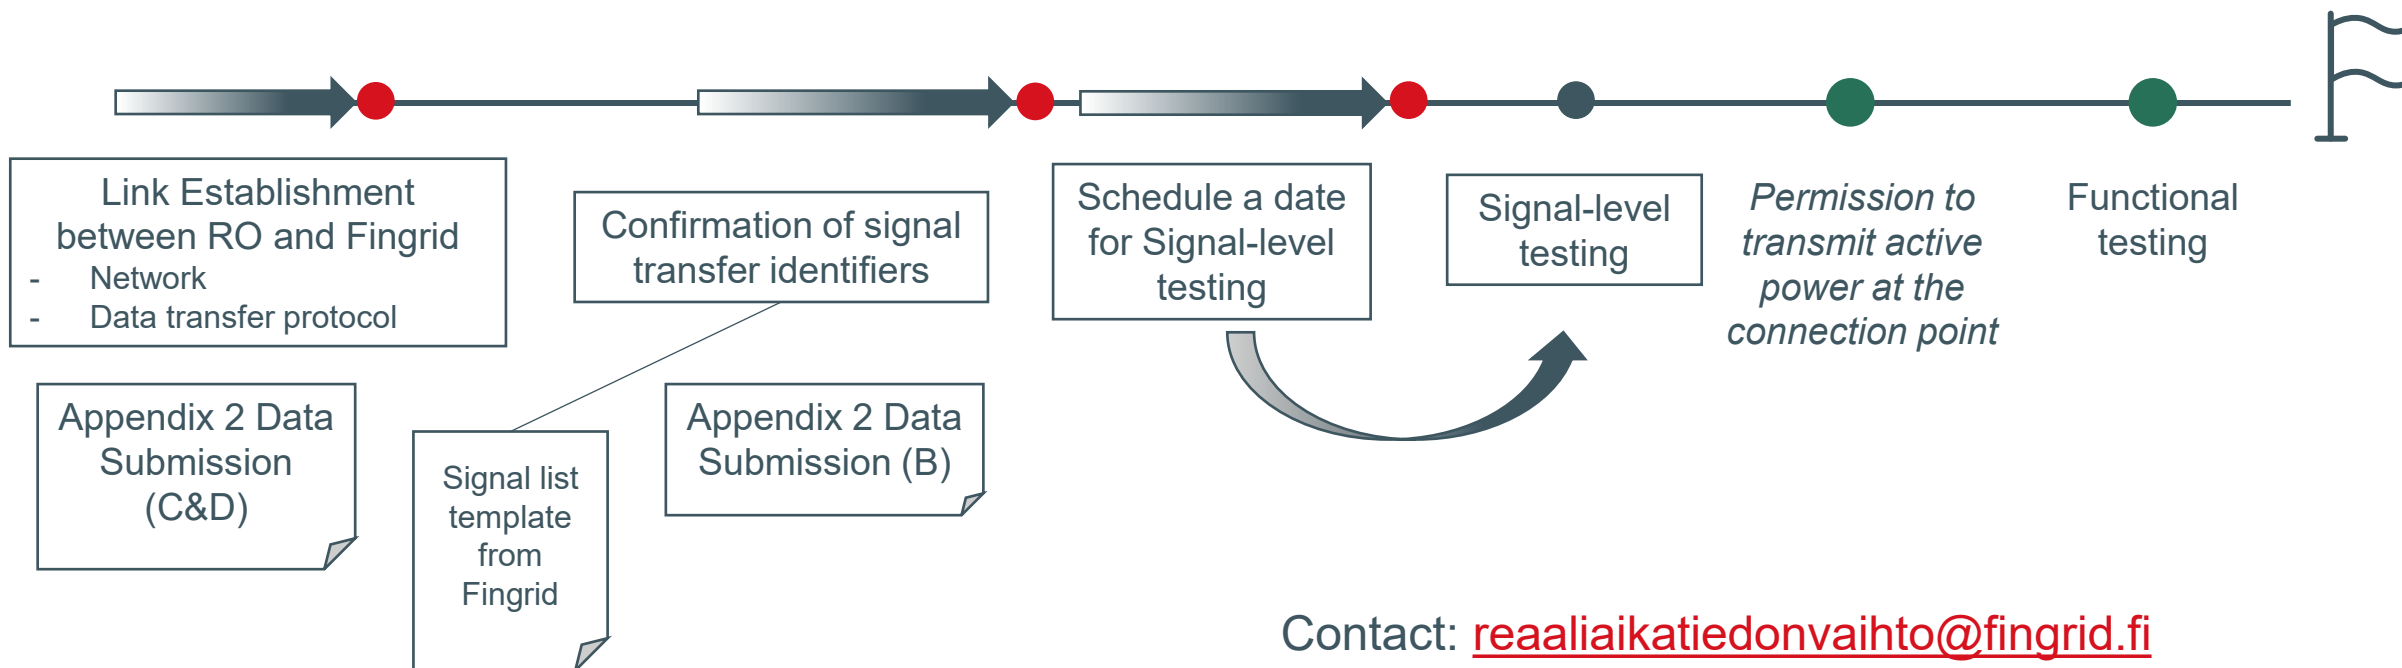

FINGRID

Signal commissioning process for VJV/SJV2024 Type B Plants

1) Link Establishment:

A communication link between the Responsible Operator (RO, KVT) and Fingrid is established in accordance with the real-time data exchange application guideline. Multiple power plants and energy storage units may share the same link based on risk assessments. The RO must contact Fingrid at voimalaitostiedot@fingrid.fi **2 months before signal testing** for the power plant or energy storage unit. The contact must clearly specify all plants connected to the same link.

2) Data Submission:

The connecting party must submit the data table as defined in Appendix 2 to Fingrid at reaaliaikatiedonvaihto@fingrid.fi.

3) Signal Transfer Identifiers:

These are defined and confirmed **2 months before signal testing**.

4) Agreement on Signal Testing:

Must be made **1 month before the start of production**.

5) Signal-Level Testing

Conducted before the start of production.

6) Commissioning Permit, Start of Production Use

Issued for the plant once the above steps are completed.

Signal commissioning process for VJV/SJV2024 Type C Plants

1) Link Establishment

A communication link between the Responsible Operator (RO, KVT) and Fingrid is established in accordance with the real-time data exchange application guideline. The same link may carry data for multiple power plants and energy storage units based on risk assessments. The RO must contact Fingrid at voimalaitostiedot@fingrid.fi at least **6 months before the planned commissioning date** of the plant or storage unit for risk assessment. The communication must clearly list all units connected via the same link.

2) Data Submission

The connecting party must submit the data specified in Appendix 2 to Fingrid at reaaliaikatiedonvaihto@fingrid.fi at least **6 months before the planned commissioning date**.

3) Signal Transfer Identifiers

Signal transfer identifiers are defined and confirmed **2 months before signal testing**. Signals requiring model verification of the plant or storage unit (e.g., voltage control setting groups) are conditionally set if simulation model testing results are not yet available at the time of signal confirmation.

4) Agreement on Signal Testing

Signal testing must be agreed upon **1 month before the start of production**.

5) Signal-Level Testing

The functionality of the signals is tested. If any changes have occurred in the data, the connecting party must resubmit the Appendix 2 data to reaaliaikatiedonvaihto@fingrid.fi before the signal tests. Testing must be successfully completed before the plant is granted permission to transmit active power.

6) Electrification and Start of Production Use

The plant is electrified and begins production use (permission to transmit active power at the connection point).

7) Functional Testing

Functional testing of the signals must be conducted as soon as possible after the plant or storage unit begins transmitting active power to the grid. This testing ensures that the plant behaves according to the given control points and that feedback values match the operational values.

Testing of active power limitation and reactive power control must be performed once the plant reaches **30% of its rated capacity**, but no later than **3 months after** the start of production. Remaining functional tests may be conducted during commissioning trials or at another agreed time.

Signal commissioning process for VJV/SJV2024 Type D Plants

1) Link Establishment

A communication link between the Responsible Operator (RO, KVT) and Fingrid is established in accordance with the real-time data exchange application guide. The same link may carry data for multiple power plants and energy storage units based on risk assessments. The RO must contact Fingrid at voimalaitostiedot@fingrid.fi at least **6 months before the target date for the Interim operational notification (ION)**. The message must clearly list all plants included in the same link.

2) Data Submission

The connecting party must submit the data specified in Appendix 2 to Fingrid at reaaliaikatiedonvaihto@fingrid.fi at least **6 months before the target ION date**.

3) Signal Transfer Identifiers

Signal transfer identifiers are defined and confirmed **2 months before signal testing**. Signals requiring model validation (e.g., voltage control setting groups) are set conditionally if simulation model testing results are not yet available at the time of confirmation.

4) Agreement on Signal Testing

Signal testing must be agreed upon **1 month before the planned test date**.

5) Signal-Level Testing

The connecting party must resubmit the Appendix 2 data to reaaliaikatiedonvaihto@fingrid.fi before signal testing if any changes have occurred. Testing must be successfully completed before the plant can be granted a temporary commissioning license (ION).

6) Interim operational notification (ION) and Start of Production Use

The plant receives the interim operational notification (ION) and begins production use (permission to transfer active power at the connection point).

7) Functional Testing

Functional testing of signals must be performed as soon as possible after the plant or energy storage unit receives the ION. The testing ensures that the plant behaves according to the given control points and that feedback values match operational values. Testing of active power limitation and reactive power control must be performed when the plant reaches **30% of its rated power**, but no later than **3 months after production start**. Remaining functional tests may be conducted during commissioning trials or at another agreed time.



Loissähkön sovellusohjeen muutokset

FINGRID

Changes to the guideline: supply of reactive power and maintenance of reactive power reserves

- Sections that are already included in the Terms and conditions for the main grid service will be removed from the guideline where applicable.
- Definitions and concepts will be clarified to align with other terms and conditions.
- For FC power plants, voltage-dependent reactive power limits also apply when drawing electricity from the main grid (cf. energy storage).
- The conditions for reactive power reserves will be clarified regarding when constant voltage control must be active (when connected to the grid).
 - A power plant is considered connected to the grid if the **generator circuit breaker is closed and the plant operates above its minimum output**. This definition also applies to energy storage, except for electrical storage connected to the grid via converters.
 - Electrical storage is considered connected to the grid if the **high-voltage circuit breaker and the circuit breakers of the converter units are closed**.



08/12/2025



Käytöstä vastaavien toimijoiden puheenvuorot

FINGRID

External / Confidential

Sustainable Energy Services

Fingrid Webinaari

26.11.2025


Assemblin Caverion Group

Together since 2024

Assemblin | Caverion



~21,900
Total employees



EUR 3.8 billion
Combined revenue



10
Countries

Our offering

- \ *Installation & Projects*
- \ *Service & maintenance*
- \ *Manage & Operate*
- \ *Advisory & Solutions*

We continue to focus on

- \ *Our people and safety*
- \ *Excellent customer service*
- \ *Technical expertise*
- \ *Smart and sustainable solutions for buildings, industry and infrastructure*



Caverion Renewable Services



24/7 Control Center
Located in Oulu, Finland

*Acts as a Relevant Operator
required by Fingrid in national
Grid Code specification
(VJV/SJV2024)
NC-ER Compliant*



Maintenance
*Substation & Grid
Turbines
Battery Energy Storage
Systems (BESS)
Solar*



Management
*Service Manager takes care of
the partnership and daily
actions*


*Electrical Operation Manager is
responsible of electrical safety of
the asset*



Expert Services
*Technical support for example
on troubleshooting and
electrical performance*

Caverion & new VJV/SJV2024

- \ **Relevant Operator (Käytöstä Vastaava Toimija)**
- \ **Operating assets beginning from 1MW onwards**
- \ **Connections to TSO and DSOs**
- \ **NC-ER compliant, also providing solution for the Asset greater than 30MW**
- \ **Disturbance Recorder service**
- \ **Enables connections to 3rd Parties, such as Market operators**

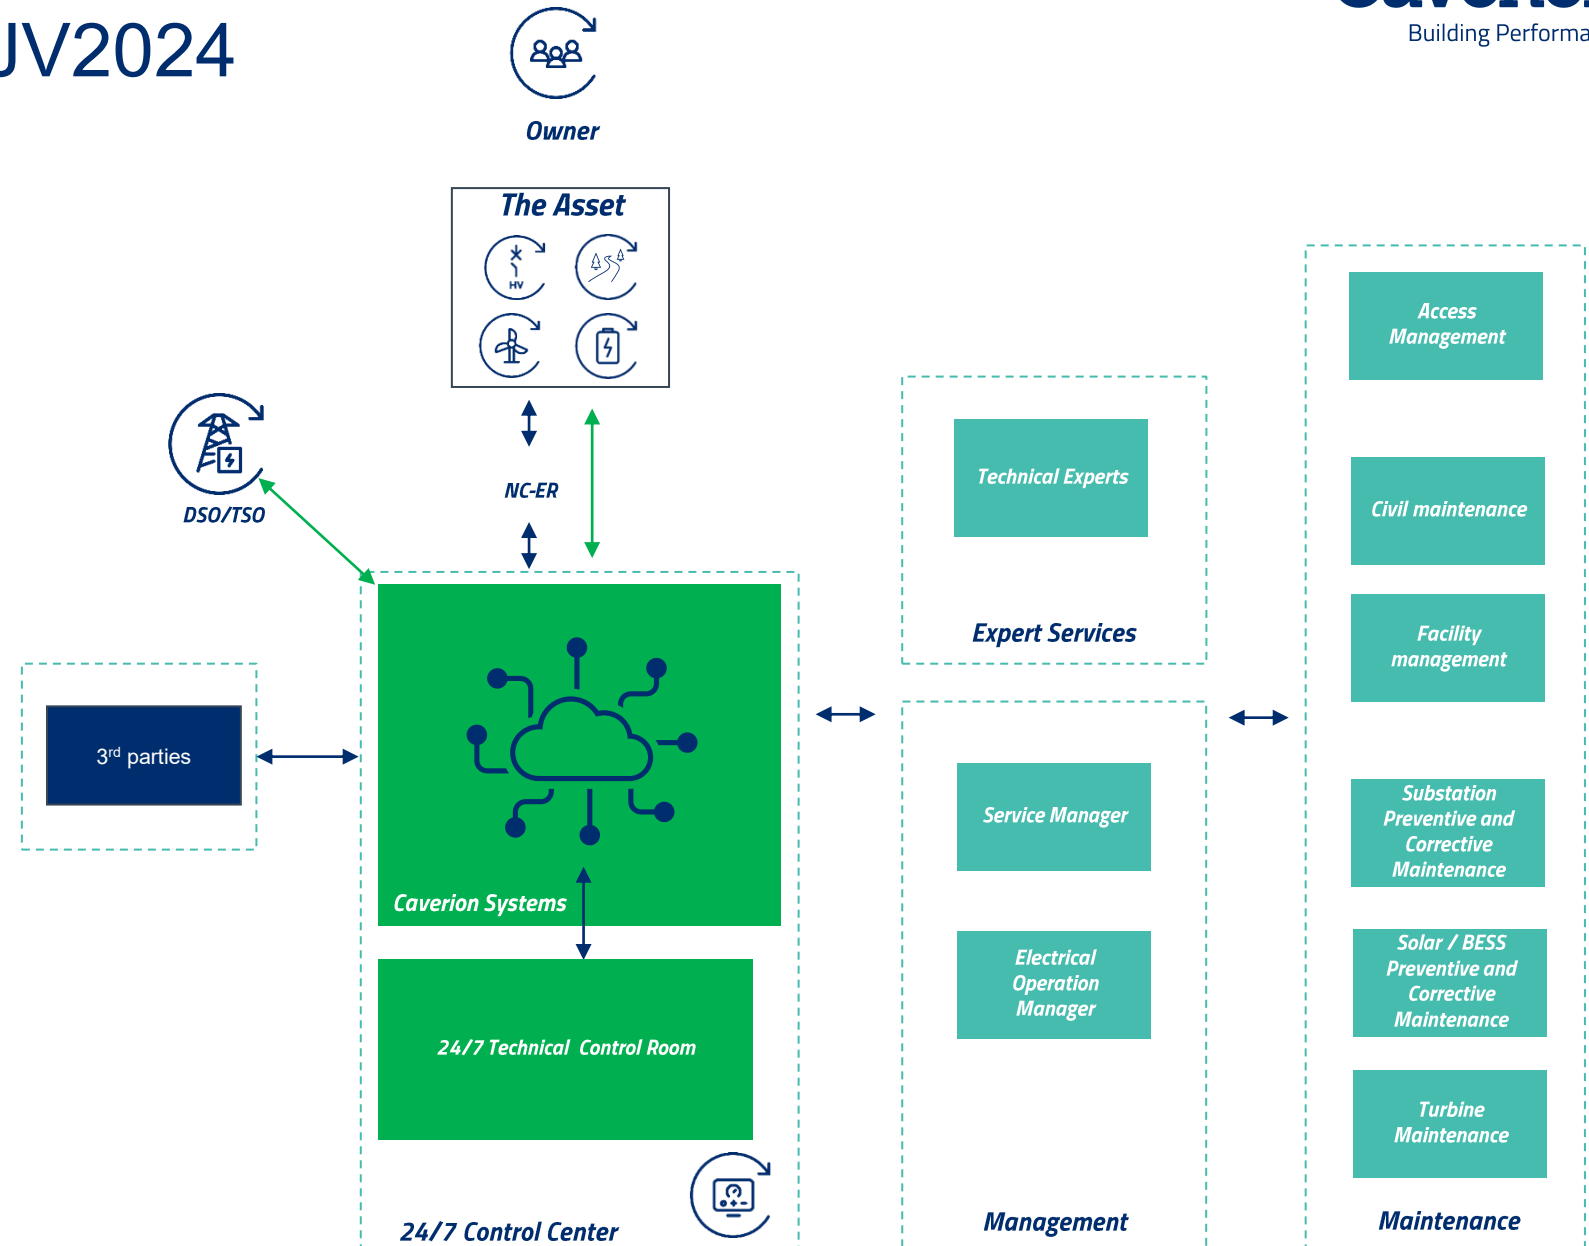



1. We meet the requirements in the VJV/SJV2024

Our infrastructure is already built to support new grid code and we will provide communication specs to our Customers accordingly

2. Updated commissioning timeline

Communication between the systems and the power plant require time and effort. Updated grid code ensures well executed commissioning projects and smooth operational phase

3. Caverion has +3500 MW renewables in operation

We are able to ensure operation with focus on production and availability enhanced with a technical understanding from grid stability to communication



Thank you!

Kimmo Kaappola, Development Manager

kimmo.kaappola@caverion.com

ENERVA

*Efficient control and monitoring of
infrastructure networks*



*Henri Heikkinen
Operations Services Manager*



26.11.2025



Enerva is a new kind of service company

A unique selection of services for the operation of infrastructure networks: a combination of operation, intelligent maintenance, and other expert services


Our slogan: We handle our customers networks like it's our own.

Customer collaboration combined with our unique set of services enables many advantages to a single customer through synergy – resulting in excellent and effective operation and monitoring of infrastructure networks.

ENERVA

26.11.2025

Assets monitored by Enerva

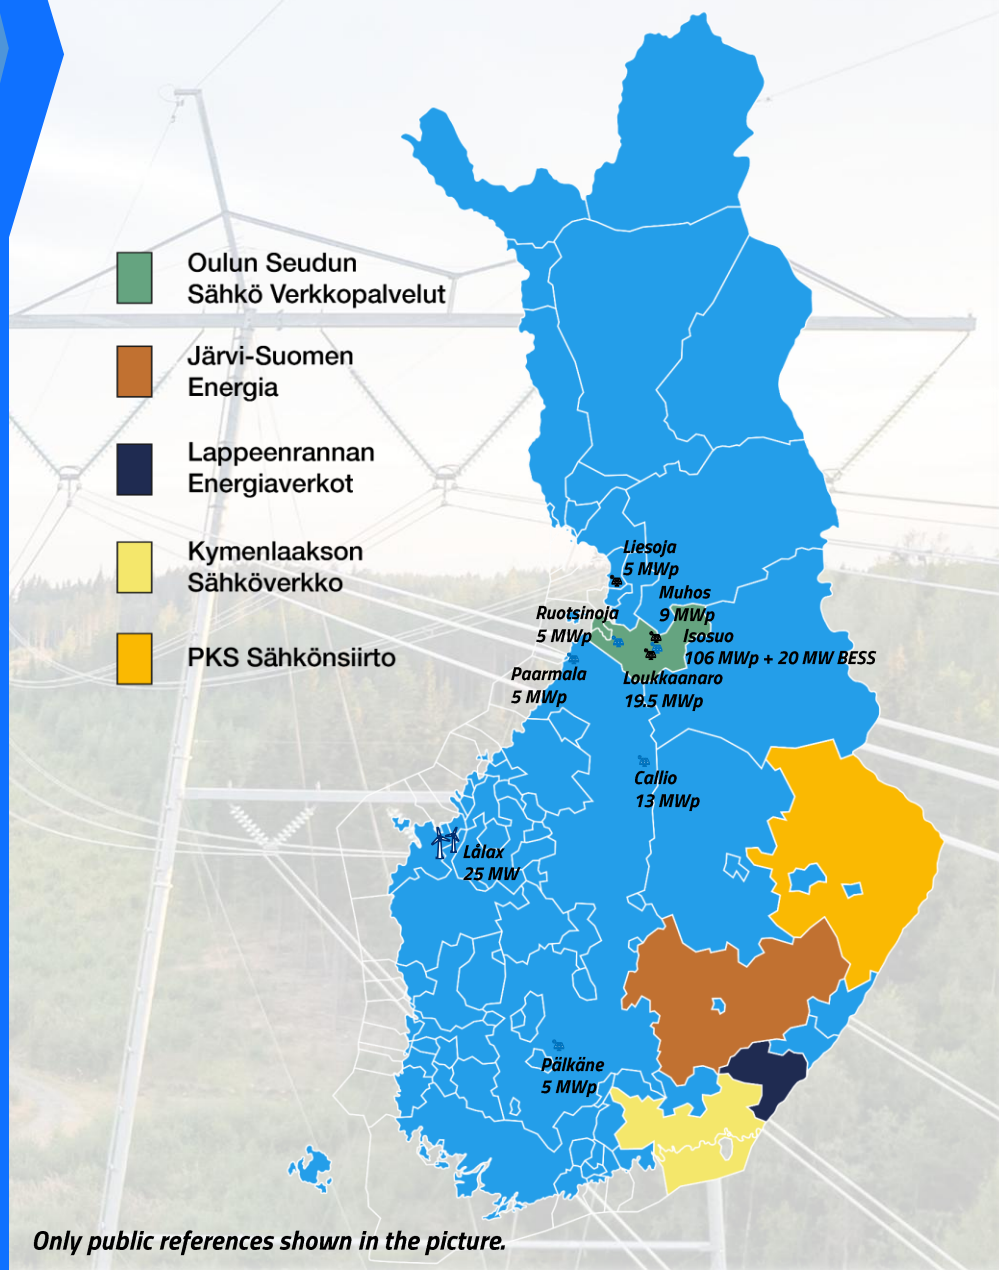

DSO networks (5)



Wind farms (2)



Solar parks (7 operative, 9 under construction or construction starting soon)



BESS (159 stand alone units operative, 61 under construction)



Demand facilities (1 under construction)

The combined power of the renewable assets under 24/7 monitoring is over 800 MW.

ENERVA

26.11.2025

Key figures of operating services

Usage points
390 000

Substations
150

Network length
75 000 km

*System interruptions and
planned outages*
~ 10 000
(around half of them are faults)

Remote controlled switch devices
6 500

Data transmitting switch devices
20 000



Why choose Enerva?

- Control center functioning 24/7/365 and handling different faults and planned outages daily.
- Own highly advanced systems with diverse options of automation and customer notifications, customer owns the data.
- Practically perfected processes with repair personnel enables safe but efficient fault management.
- World class cyber security
 - In accordance with NIS2 and ISO27001
- Critical control center (NC ER) with at least 24h performance in a national black out situation.
 - Geographically four (4) times redundant.
- Our expertise available to our customers beyond control center services: substations, relays, remote control, SCADA etc.

Service options

S
E
R
V
I
C
E
S

Core Services



*Highly advanced
systems for your
network*



*Experienced
operators 15+*



*State of the art
cyber security
solutions*

*Control and
monitoring
center
24/7/365
(NC ER)*

Complementary Services



*Electrical
operations
manager as a
service
(Required by law)*



*24h fault repairs
with a fast
response time*




Maintenance

Additional services

*Maintenance
planning*



Relay planning



*System solutions
NC ER as a service
Camera surveillance ...*

ENERVA

26.11.2025



THANK YOU



Who to contact:
Petri Pelli (CEO)
petri.pelli@enerva.fi
+358 50 372 4344



26.11.2025


Operation Center Services

FINGRID WEBINAR 26.11.2025



REJLERS

24/7 OPERATION CENTER

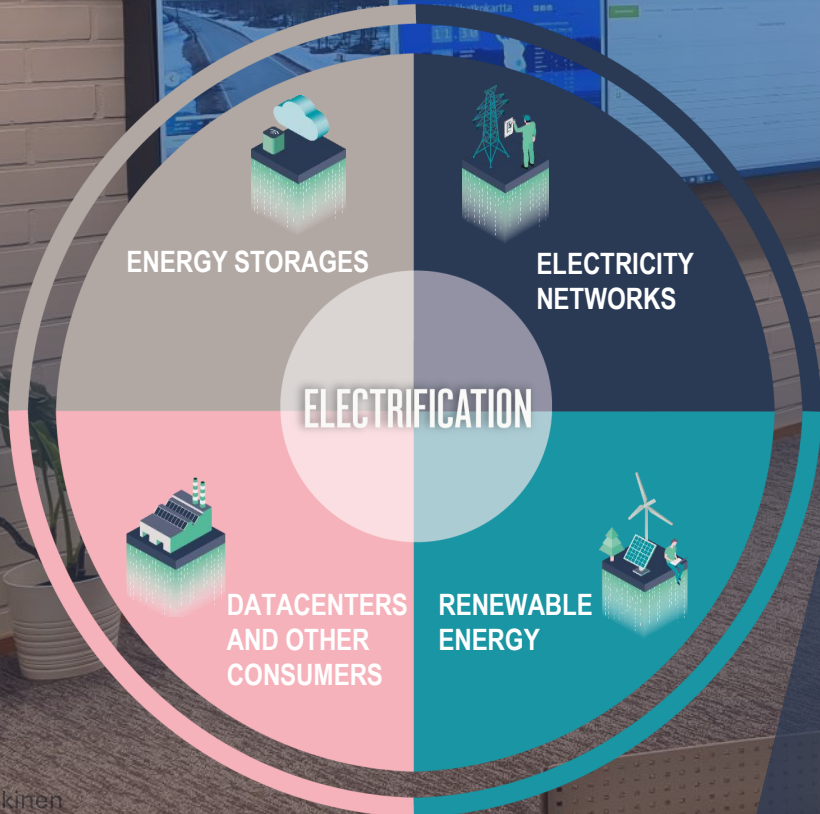

+ NC ER COMPLIANT OPERATION CENTER – KOVA-FEN CONNECTION AND KOVA-PHONE WITH 24 H POWER SUPPLY.

+ EXTENSIVE AND VERSATILE NETWORK OF RELIABLE PARTNERS – TAILORED SERVICES FOR CUSTOMER'S EXACT NEEDS.

+ AS A LEADING TECHNOLOGY CONSULTANT IN NORDICS, WE HAVE A BROAD IN-HOUSE EXPERTISE AND EXPERT PERSONNEL IN THE ENERGY SECTOR.

OPERATION CENTER SERVICES:

- ✓ 24/7 ASSET OPERATION MANAGEMENT
- ✓ ROLE OF RELEVANT OPERATOR (KVT)
- ✓ REAL-TIME DATA EXCHANGE TO TSO, DSO, 3RD PARTIES
- ✓ ENSURING RESERVE MARKET OPERATIONS (AFRR & MFRR)
- ✓ NC ER RELATED SERVICES
- ✓ ELECTRICAL OPERATIONS MANAGEMENT
- ✓ MAINTENANCE MANAGEMENT
- ✓ GRID COMPLIANCE SUPPORT (VJV, SJV, NC ER)
- ✓ VIDEO SURVEILLANCE (CCTV)
- ✓ SERVICES FOR MGA BALANCE SETTLEMENT, METERING DATA MANAGEMENT AND DATA TRANSFER TO MARKET PARTIES


24/7 Operation Center

CUSTOMER'S RELIABLE PARTNER IN ASSET OPERATION MANAGEMENT

- Rejlers' Operation Center's main goal is to help our Customers achieve their desired operational targets and profits from investments through quality operation management.
- Rejlers Operation Center provides cyber secured operation & management services 24/7/365 with years expertise.
 - Fast response times in failure situations.
 - Strong experience and expertise from control room operations and electricity distribution process.
 - Up to date and extensive operation center systems.
 - DMS operation support system in use.
 - Strong in-house expertise regarding systems, communications and cyber security.
 - 24/7/365 back-up from system manufacturer on SCADA and it's also redundant (HSBR).
 - Refined and efficient processes shaped through continuous development and years expertise.
- Rejlers' scalable Operation Center services offers cost savings and the tailored fit to Customer's exact needs.
 - Easy upscale of investments and operations through Rejlers' tested and trusted operating models and extensive partner network.



Broad electrification offering to deliver the green transition from Rejlers.

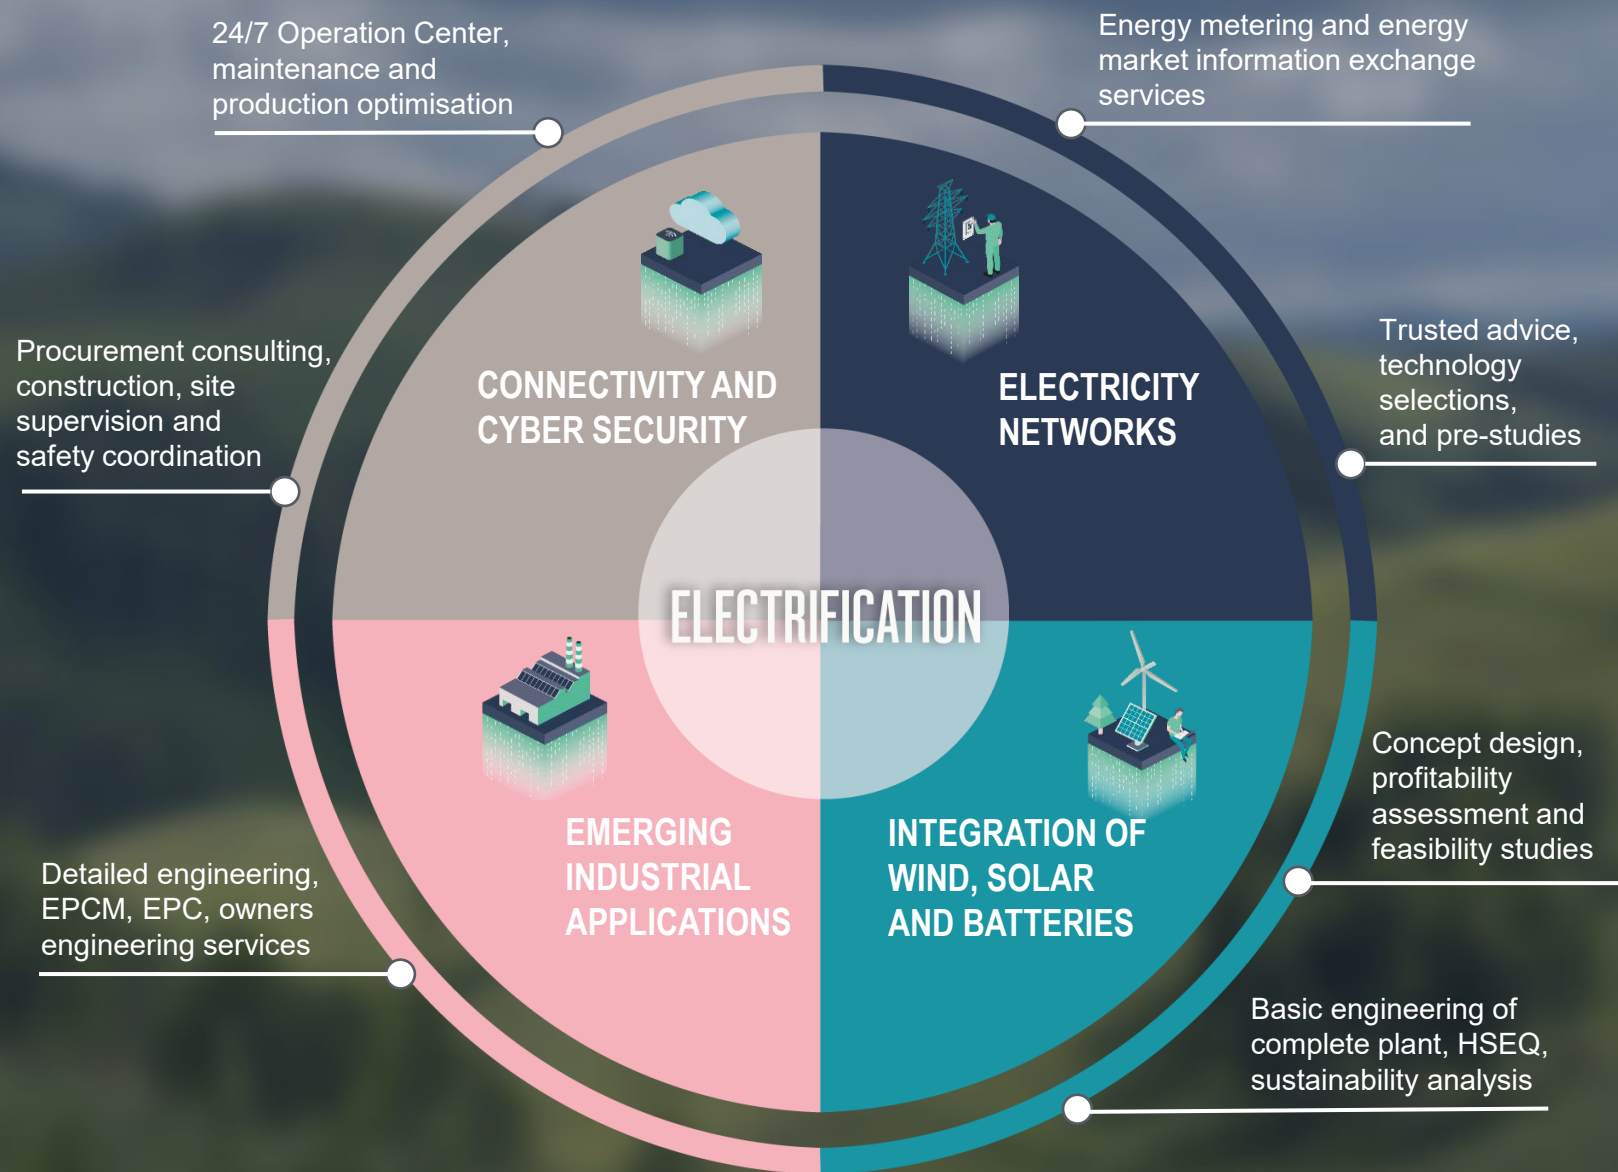

Certified management systems



ISO 9001:2015
Quality management



ISO 14001:2015
Environmental management
system



ISO 27001:2022
Information security
management system



ISO 45001:2015
Occupational health
and safety

THANKS!




Joni Ahonen

Business Line Director, Power Grids
joni.ahonen@rejlers.fi
+358 40 801 1758



Ismo Reinikka

Business Unit Manager, Operation Center
ismo.reinikka@rejlers.fi
+358 50 589 2104



Matias Savolainen

Development Manager, Power Grids
matias.savolainen@rejlers.fi
+358 40 801 1776



etunimi.sukunimi@rejlers.fi



+358 207 520 700 (Vaihde)



www.rejlers.com

Smart Energiapalvelut 24h Valvomo


Käyttökeskus valvoo ympäri vuorokauden

Käytöstä Vastaava Toimija - KVT

- ▶ Pitkä kokemus käytönvalvonnasta (n. 40 vuotta)
- ▶ Toimitaan NC ER (Network Code for Emergency and Restoration), VJV2024 ja SJV2024 säädösten mukaisesti (24h valmius, KoVa FEN ja Puhe, jne)
- ▶ Asiakasyhtiöinä mm:
 - ▶ Sähkövarastot, Voimalaitokset, jne
 - ▶ Yhdeksän jakeluverkkoyhtiötä
 - ▶ n. 111 000 käyttöpaiikkaa
- ▶ Toimitaan koko Suomen alueella

Järjestelmät

- ▶ Hitachi MicroScada X 10.7 käytönvalvontajärjestelmä "Hot-Standby"
 - ▶ IEC104 ja IEC61850 protokollatuki
 - ▶ KoVa FEN yhteys
 - ▶ Reaaliaikainen tiedonvaihto
- ▶ Trimble NIS verkkotieto- ja Trimble DMS käytöntukijärjestelmät, UTG ja webTCC

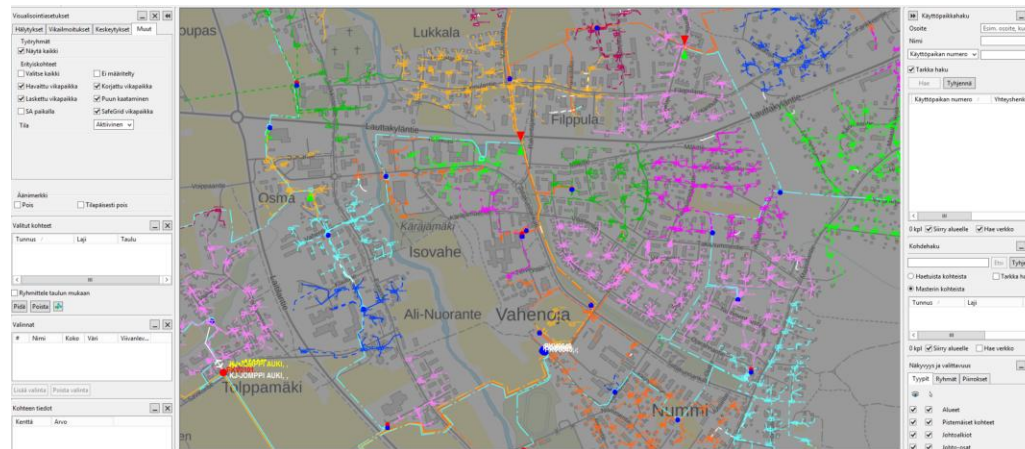

Palvelutarjonta

- ▶ Smart Energiapalveluiden kautta hoituu KVT toimijan reaaliaikainen tiedonvaihto Fingridille KoVa yhteyksiä pitkin
 - ▶ Tarjotaan palveluna NC ER, VJV2024 ja SJV2024 ohjeistuksen mukaiset tiedonvaihtopalvelut
 - ▶ Sähkövarastot, voimalaitokset, jakeluverkkoyhtiöt, jne
- ▶ Käytöstä Vastaava Toimija, KVT
 - ▶ 24h toimintakyky, KoVa yhteydet, sähköpulatilanteiden hallinta, reaaliaikamittaukset alitaajuussuojauksen portailta, jne
- ▶ Käytönvalvontajärjestelmä, Scada
- ▶ Verkkotieto ja käytöntukijärjestelmä, Trimble NIS, DMS, UTG
- ▶ Integrointipalvelut ja muut oheispalvelut

Sertifikaatit

- ▶ Sertifikaatit
 - ▶ ISO 27001 (ISMS, tietoturvallisuuden hallintamalli)
 - ▶ ISO 27701 (PIMS, tietosuojan hallintamalli)
 - ▶ ISO 9001
- ▶ Noudatetaan kaikessa toiminnassa
- ▶ Sertifikaattien voimassaolo vahvistetaan vuosittain seuranta-auditointien yhteydessä
- ▶ Laadunhallinnan pohjana käytetään ISO 9001 standardia, joka on myös sertifioitu

Tietoturva

- ▶ Käytössä korkeatasoiset ja kokonaisvaltaiset tietoturvaratkaisut
- ▶ Cyber Security Operations Center (CSOC) -palvelu, jonka avulla seuraamme ympäristöä reaaliaikaisesti ja analysoimme siellä mahdollisesti esiintyvää poikkeuksellista liikennettä
- ▶ CSOC sisältää mm.
 - ▶ 24/7-valvonta
 - ▶ Häiriötilanteiden nopea tunnistaminen
 - ▶ Hälytys- ja reagointipalvelu
 - ▶ SIEM, lokienhallinta sekä haavoittuvuuskannaukset

Valvomon toimitilat

- ▶ Sijainti: Ulvila
- ▶ Reittivarmennetut kuituyhteydet
- ▶ Sähkönsyöttö varmennettu 24h
 - ▶ Varavoimakone + UPS järjestelmä
- ▶ KoVa FEN ja puhe palvelut
- ▶ Satelliittiyhteydet

- ▶ <https://smartenergia.fi/>



08/12/2025



Aikaa kysymyksille

FINGRID

Thank you

08/12/2025

Contact details:

real-time signals and data exchange related questions:


reaaliaikatiedonvaihto@fingrid.fi

VJV, SJV or KJV

Contact details from our website

[Järjestelmätekniset vaatimukset – Fingrid](#)

[Grid code specifications - Fingrid](#)

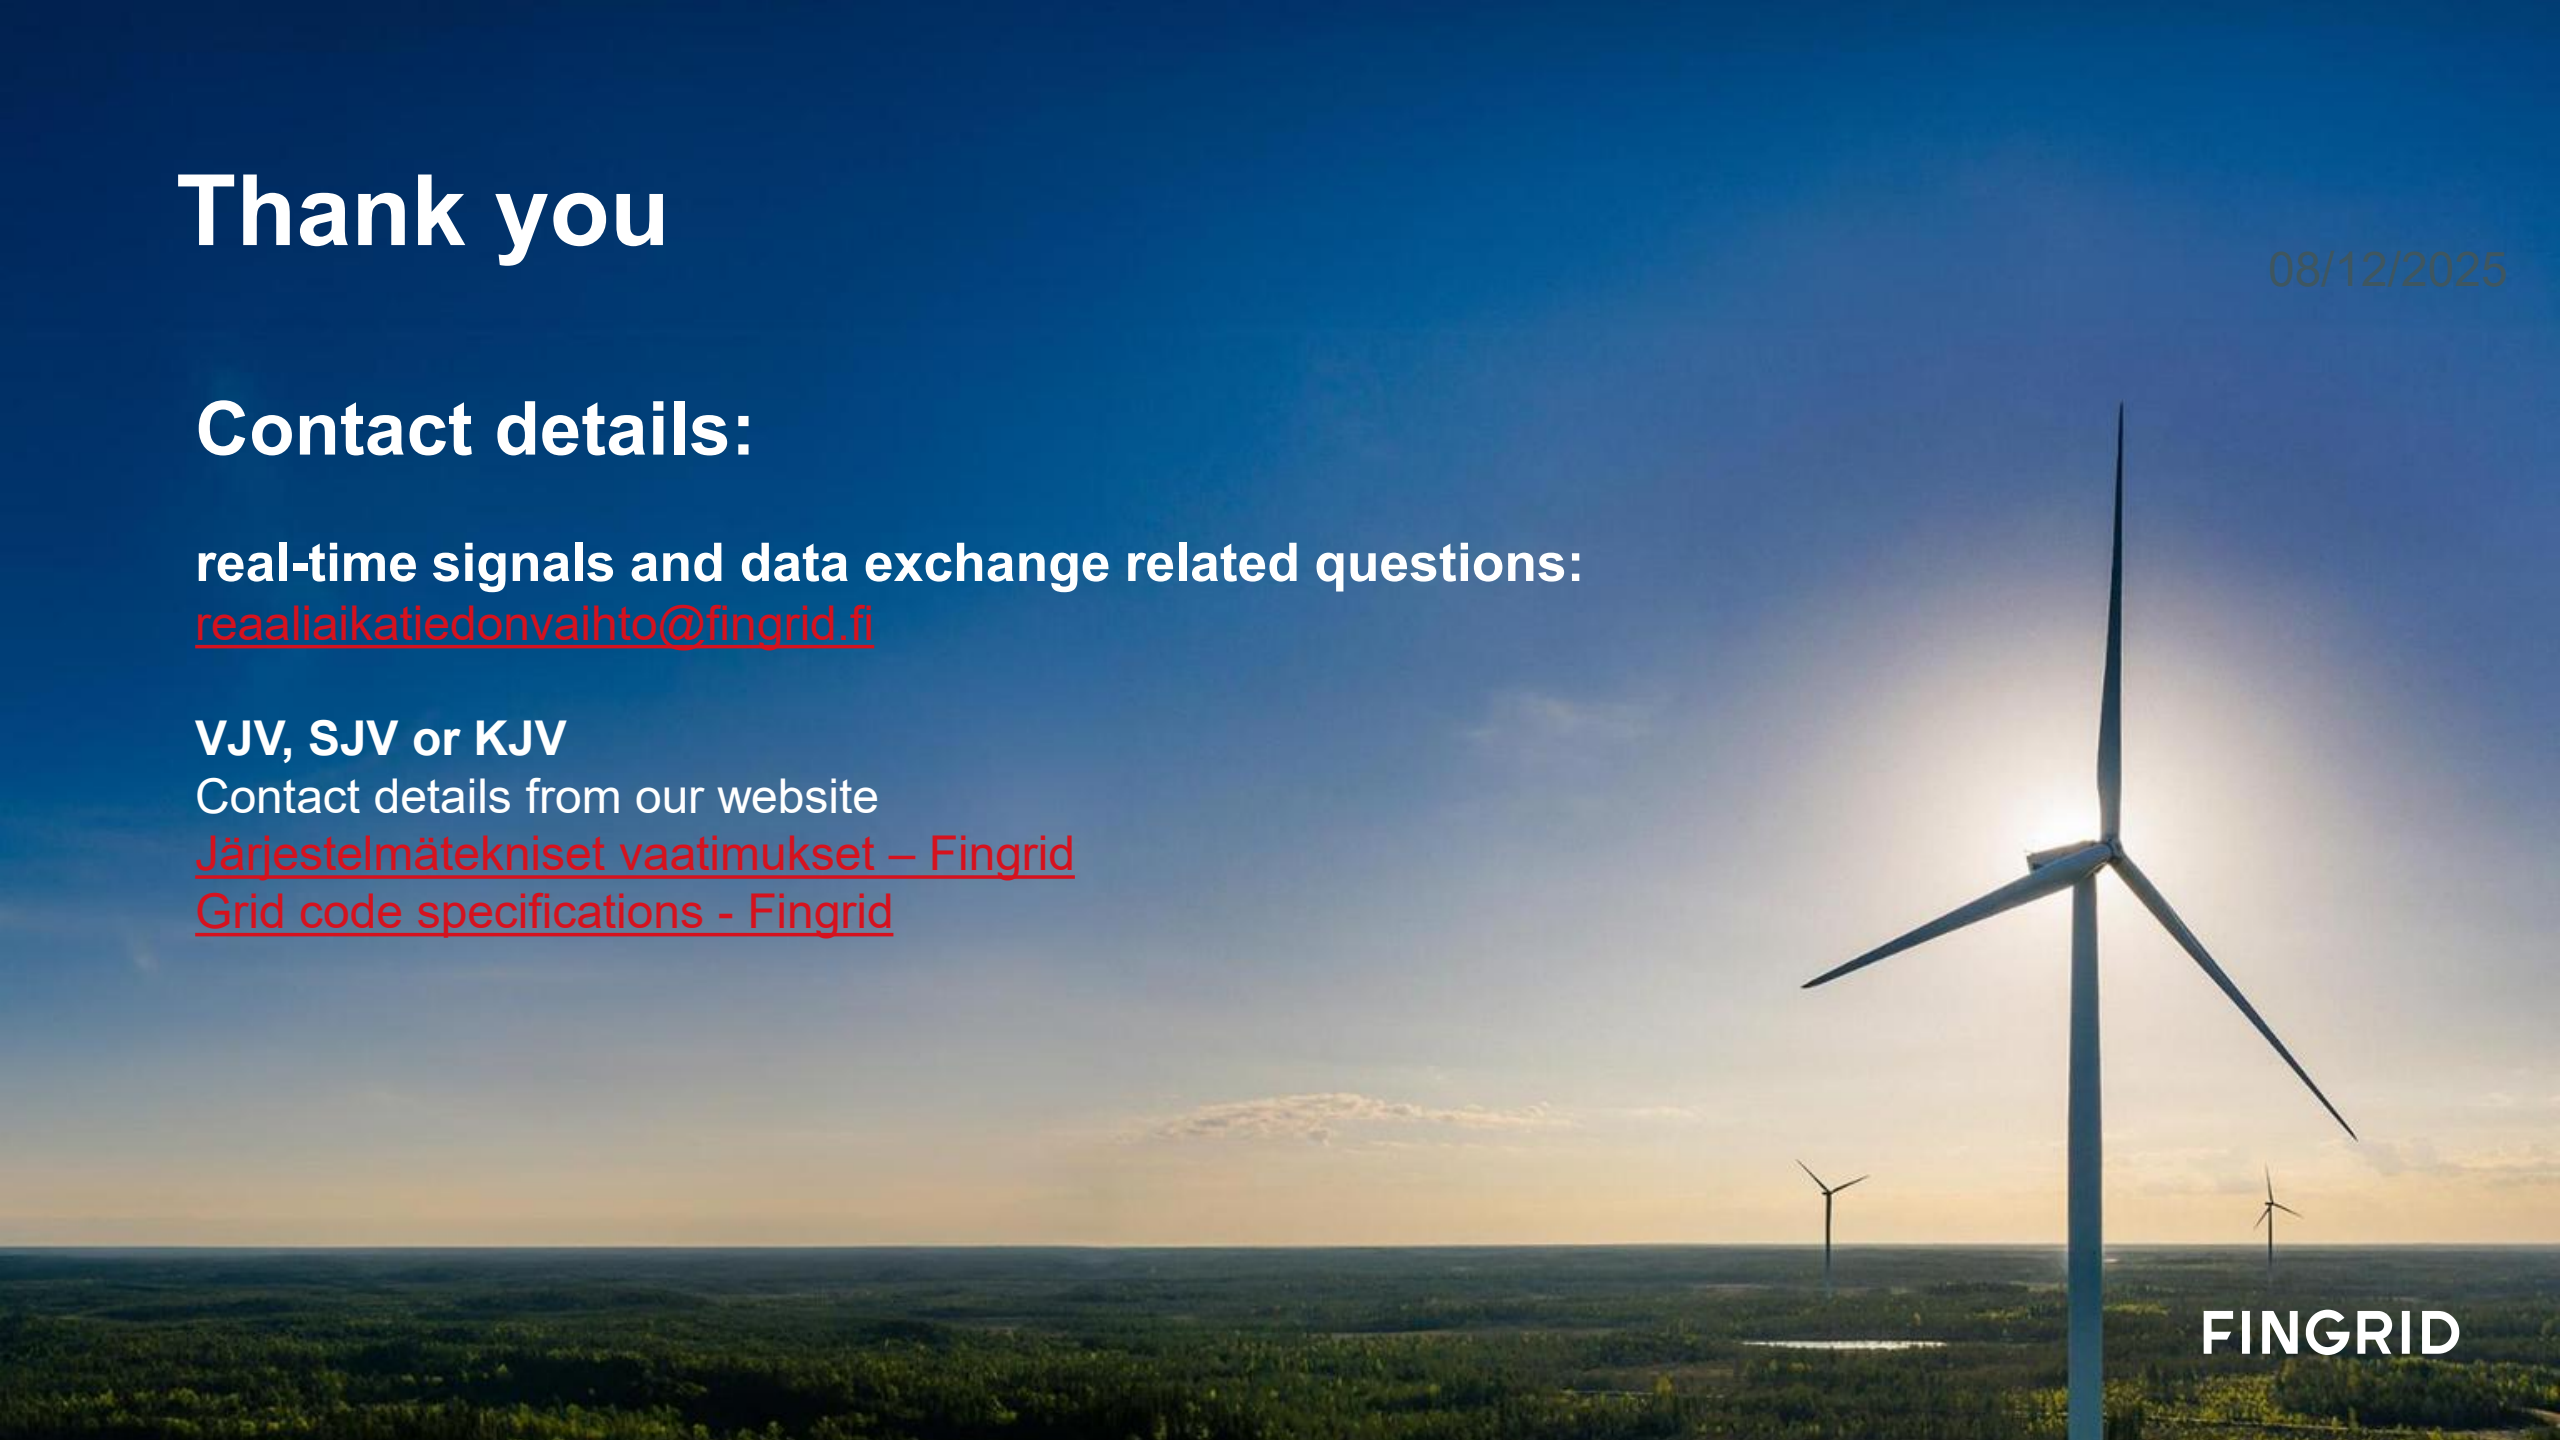

FINGRID